

Mass Flow Meter (MFM) for Gases



Type 8703 can be combined with...



Type 0330

3/2 or 2/2-way
valve



Type 6013

2/2-way valve

- Direct flow measurement by MEMS- Technology for nominal flow rates from 10 ml_N/min to 80 l_N/min (N₂)
- High accuracy
- Short response time
- Compact design and digital communication

Mass flow meter are used in process technology for the direct measurement of the mass flow of gases. In case of volumetric flow meters, it is necessary to measure the temperature and the pressure or the density, because gases change their density or rather their volume depending on the pressure. The measurement of the mass flow, on the other hand, is independent of the pressure and temperature.

The digital mass flow meter type 8703 uses a sensor on silicon chip

basis located directly in contact with the gas. Due to the fact that the sensor is directly in the bypass channel a very fast response time of the MFM is reached. The actual flow is given over RS485-communication. Type 8703 can optionally be calibrated for two different gases, the user is able to switch between these two gases. This instrument communicates with master devices digitally, no further A/D conversions needed.

| Technical Data | | | |
|---|---|--|--|
| Nominal flow range¹⁾ (Q _{nominal}) | 10 ml _N /min ²⁾ to 80 l _N /min (N ₂), see table on p. 2 | Power supply | 24V DC |
| Turn-down ratio | 1:50, higher turn-down ratio on request | Voltage tolerance | ±10% |
| Operating gas | Neutral, non-contaminated gases, on request | Residual ripple | < 2% |
| Calibration gas | Operating gas or air with conversion factor | Power consumption | Max. 11.5 W (depending on control valve used) |
| Max. operating pressure (Inlet pressure) | 10 bar (145 psi) depending on the orifice of the valve | Communication | Digital via RS485 (half-duplex or full-duplex), RS422, RS232 via adapter |
| Gas temperature | -10 to +70°C (-10 to +60°C with oxygen) | Protection class | IP40 |
| Ambient temperature | -10 to +50°C ³⁾ | Dimensions [mm] | see drawings p. 5-6 |
| Accuracy | ±0.8% o.R. ±0.3% F.S. (after 1 min. warm up time) | Total weight | ca. 500 g (aluminium body) |
| Repeatability | ±0.1% F.S. | Installation | horizontal or vertical |
| Response time (t_{95%}) | < 300 ms | Light emitting diodes (default functions, other functions programmable) | Indication for power, limit and error |
| Materials | | Binary inputs (default functions, other functions programmable) | Two 1. Start Autotune 2. not assigned |
| Body | Aluminium or stainless steel | Binary output (default functions, other functions programmable) | One relay output for: 1. Limit (setpoint not reached) Max. Load: 25V, 1A, 25VA |
| Housing | Metal | | |
| Seals | FKM, EPDM | | |
| Port connection | NPT 1/4, G 1/4, screw-in fitting or sub-base, others on request | | |
| Electr. connection | Plug D-Sub 9-pin | | |

¹⁾ The nominal flow value is the max. flow value calibrated which can be controlled. The nominal flow range defines the range of nominal flow rates (full scale values) possible.

²⁾ Index N: Flow rates referred to 1.013 bar and 0° C.
Alternatively Index S which refers to 1.013 bar and 20° C.


³⁾ Higher temperature on request.

По вопросам продаж и поддержки обращайтесь:

| | | | |
|---------------------------------|----------------------------------|------------------------------------|-------------------------------|
| Архангельск +7 (8182) 45-71-35 | Калининград +7 (4012) 72-21-36 | Новороссийск +7 (8617) 30-82-64 | Сочи +7 (862) 279-22-65 |
| Астана +7 (7172) 69-68-15 | Калуга +7 (4842) 33-35-03 | Новосибирск +7 (383) 235-95-48 | Ставрополь +7 (8652) 57-76-63 |
| Астрахань +7 (8512) 99-46-80 | Кемерово +7 (3842) 21-56-70 | Омск +7 (381) 299-16-70 | Сургут +7 (3462) 77-96-35 |
| Барнаул +7 (3852) 37-96-76 | Киров +7 (8332) 20-58-70 | Орел +7 (4862) 22-23-86 | Сызрань +7 (8464) 33-50-64 |
| Белгород +7 (4722) 20-58-80 | Краснодар +7 (861) 238-86-59 | Оренбург +7 (3532) 48-64-35 | Сыктывкар +7 (8212) 28-83-02 |
| Брянск +7 (4832) 32-17-25 | Красноярск +7 (391) 989-82-67 | Пенза +7 (8412) 23-52-98 | Тверь +7 (4822) 39-50-56 |
| Владивосток +7 (4232) 49-26-85 | Курск +7 (4712) 23-80-45 | Первоуральск +7 (3439) 26-01-18 | Томск +7 (3822) 48-95-05 |
| Владимир +7 (4922) 49-51-33 | Липецк +7 (4742) 20-01-75 | Пермь +7 (342) 233-81-65 | Тула +7 (4872) 44-05-30 |
| Волгоград +7 (8442) 45-94-42 | Магнитогорск +7 (3519) 51-02-81 | Ростов-на-Дону +7 (863) 309-14-65 | Тюмень +7 (3452) 56-94-75 |
| Воронеж +7 (4732) 12-26-70 | Москва +7 (499) 404-24-72 | Рязань +7 (4912) 77-61-95 | Ульяновск +7 (8422) 42-51-95 |
| Екатеринбург +7 (343) 302-14-75 | Мурманск +7 (8152) 65-52-70 | Самара +7 (846) 219-28-25 | Уфа +7 (347) 258-82-65 |
| Иваново +7 (4932) 70-02-95 | Наб.Челны +7 (8552) 91-01-32 | Санкт-Петербург +7 (812) 660-57-09 | Хабаровск +7 (421) 292-95-69 |
| Ижевск +7 (3412) 20-90-75 | Ниж.Новгород +7 (831) 200-34-65 | Саранск +7 (8342) 22-95-16 | Чебоксары +7 (8352) 28-50-89 |
| Иркутск +7 (3952) 56-24-09 | Нижневартонск +7 (3466) 48-22-23 | Саратов +7 (845) 239-86-35 | Челябинск +7 (351) 277-89-65 |
| Йошкар-Ола +7 (8362) 38-66-61 | Нижекамск +7 (8555) 24-47-85 | Смоленск +7 (4812) 51-55-32 | Череповец +7 (8202) 49-07-18 |
| Казань +7 (843) 207-19-05 | | | Ярославль +7 (4852) 67-02-35 |

сайт: burkert.pro-solution.ru | эл. почта: btk@pro-solution.ru
телефон: 8 800 511 88 70


Measurement principle

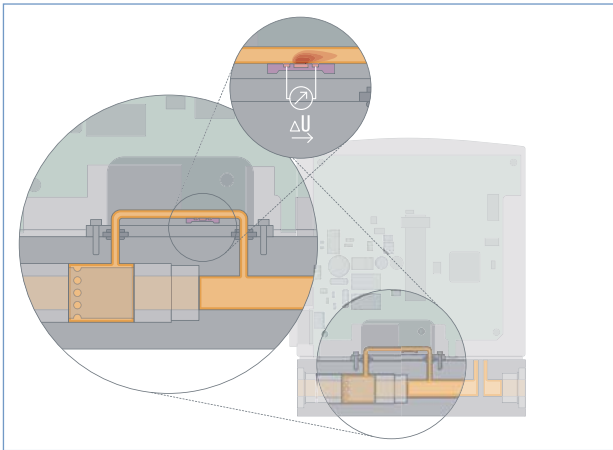

The actual flow rate is detected by a sensor. This operates according to a thermal principle which has the advantage of delivering the mass flow without any corrections for the required pressure or temperature.

A small part of the total gas stream is diverted into a small, specifically designed bypass channel, that ensures laminar flow conditions. The sensor element is a chip immersed into the wall of this channel. The chip, produced in MEMS technology, contains a heating resistor and two temperature sensors (thermopiles) which are arranged symmetrically upstream and downstream of the heater. The differential voltage of the thermopiles is a measure of the mass flow rate passing this bypass channel. The calibration procedure effectuates a unique assignment of the sensor signal to the total flow rate passing the device.

Pressure Loss Diagram (ref. to air, with 250µm inlet filter)

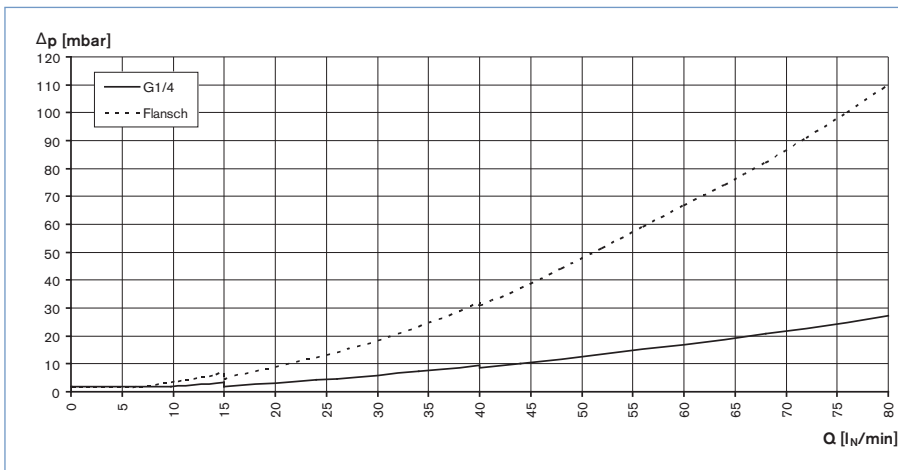

The diagram shows exemplarily the pressure loss characteristics when air flowing through.

For determining the pressure loss with another gas it needs to calculate the air equivalent and respect the fluidics needed with the other gas.

Notes regarding the selection of the unit

(Other gases on request)

| Gas | Min. $Q_{N\text{om}}$ [l _N /min] | Max. $Q_{N\text{om}}$ [l _N /min] |
|----------------|--|--|
| Argon | 0.01 | 80 |
| Helium | 0.01 | 500 |
| Carbon dioxide | 0.02 | 40 |
| Air | 0.01 | 80 |
| Methane | 0.01 | 80 |
| Oxygen | 0.01 | 80 |
| Nitrogen | 0.01 | 80 |
| Hydrogen | 0.01 | 500 |

Notes regarding the selection of the unit

The decisive factors for the perfect functioning of an MFM within the application are the fluid compatibility, the normal inlet pressure and the correct choice of the flow meter range. The pressure drop over the MFM depends on the flow rate and the operating pressure.

► The request for quotation form on page 6 contains the relevant fluid specification.


Ordering table for accessories

| Article | Item no. |
|--|----------|
| 9-pin electrical connection | |
| D-Sub socket 9-pin solder connection with housing | 917 623 |
| Adapters ⁴⁾ | |
| RS232 adapter for connection with an extension cable (item NO.917 039) | 667 530 |
| Computer extension cable for RS232 9-pin socket/plug 2m | 917 039 |
| USB adapter (version 1.1, USB-socket type B) | 670 693 |
| Communication software "MassFlowCommunicator" | |


⁴⁾ Das Adapterzubehör dient der Inbetriebnahme und Diagnose und ist nicht zwingend für den Betrieb erforderlich

Software MassFlowCommunicator for Communication with Bürkert MFC/MFM

The communication software allows the user to program additionally various functions. For that purpose the MFC or MFM has to be connected to the computer by a RS232 adapter.

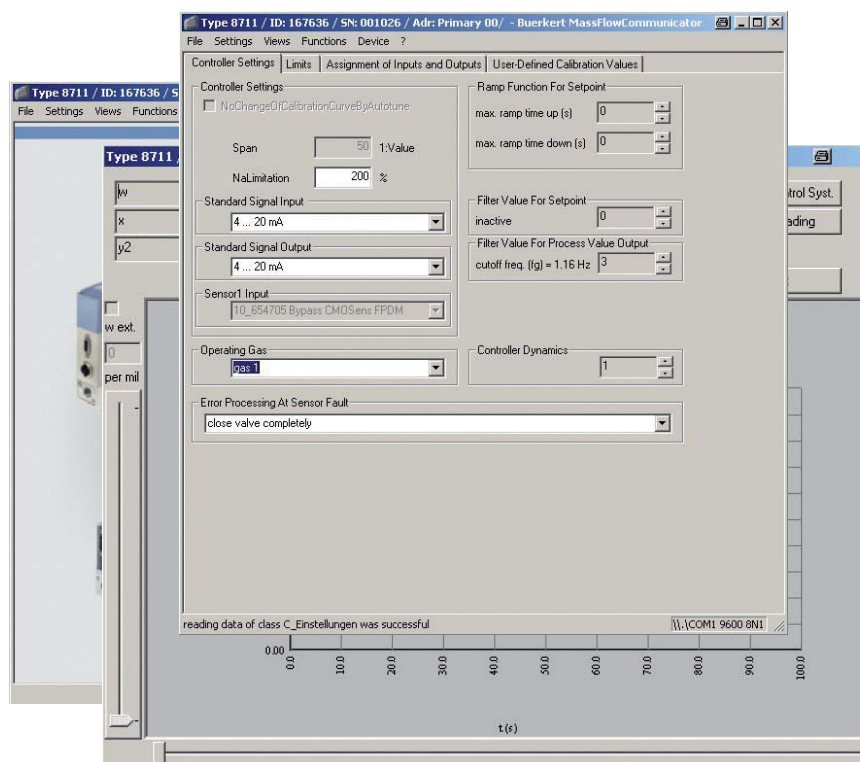


Pin Assignment

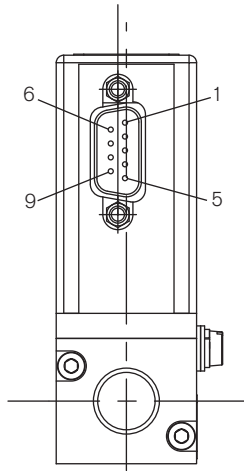


| Pin | Connection |
|-----|--|
| 1 | Binary input (related to GND Pin 2) |
| 2 | GND |
| 3 | Power supply +24V DC |
| 4 | Relay, C contact |
| 5 | Relay, NC contact |
| 6 | TX+ (RS485-Y) – bridge with pin 9 at half-duplex |
| 7 | TX- (RS485-Z) – bridge with pin 8 at half-duplex |
| 8 | RX- (RS485-B) |
| 9 | RX+ (RS485-A) |

Networking

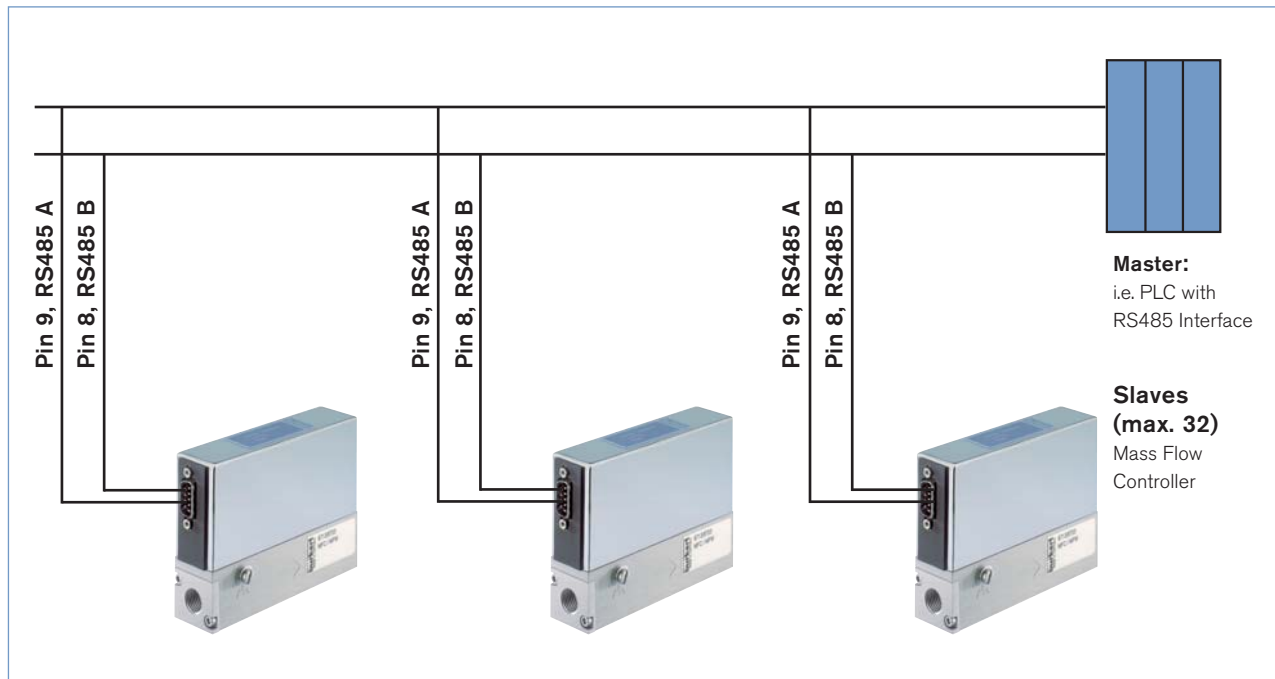


Dimensions [mm]

Threaded version

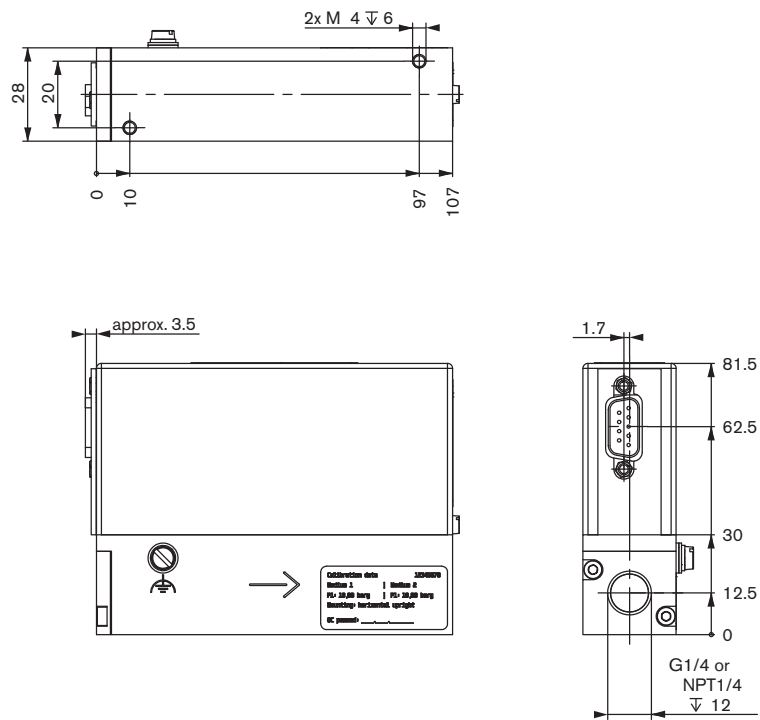

Sub-base version

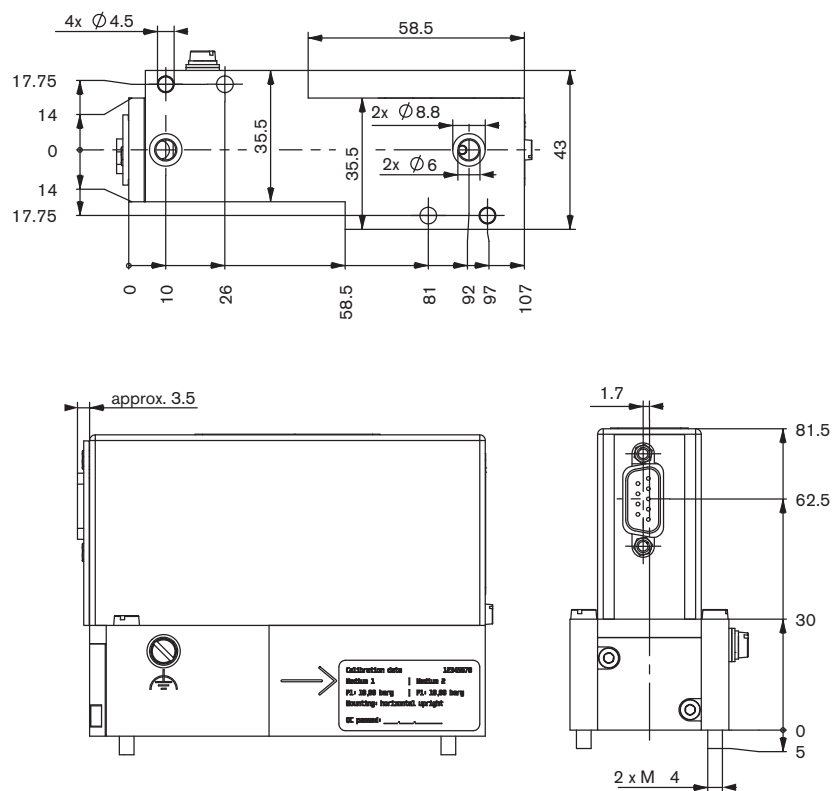

Note

You can fill out the fields directly in the PDF file before printing out the form.

MFC/MFM-applications - Request for quotation

► Please complete and send to your nearest Bürkert sales centre

| | |
|---------------|----------------|
| Company | Contact person |
| Customer No | Department |
| Address | Tel./Fax |
| Postcode/Town | E-mail |

☐ MFC-Application ☐ MFM-Application Quantity Required delivery date

Medium data

Type of gas (or gas proportion in mixtures)

Density kg/m³ ⁵⁾

Gas temperature [°C or °F] °C °F

Moisture content g/m³

Abrasive components/solid particles ☐ no ☐ yes, as follows:

Fluidic data

Flow range Q_{nom} Min. ☐ l_N/min ⁵⁾ ☐ l_S/min (slpm) ⁶⁾
 Max. ☐ m_N³/h ⁵⁾ ☐ kg/h
☐ cm_N³/min ⁵⁾ ☐ cm_S³/min (sccm) ⁶⁾
☐ l_N/h ⁵⁾ ☐ l_S/h ⁶⁾

Inlet pressure at Q_{nom} ⁷⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure P_{1max} bar(g) ■

MFC/MFM port connection ☐ without screw-in fitting
☐ 1/4" G-thread (DIN ISO 228/1)
☐ 1/4" NPT-thread (ANSI B1.2)
☐ with screw-in fitting (acc. to specification for pipeline)
 mm pipeline (external Ø)
 inch pipeline (external Ø)
☐ Flange version

Installation ☐ horizontal
☐ vertical, flow upwards ☐ vertical, flow downwards

Ambient temperature °C

Material data

Body ☐ Aluminium ☐ Stainless steel

Seal ☐ FKM ☐ EPDM

■ Please quote all pressure values as overpressures with respect to atmospheric pressure bar(ü)

5) at: 1,013 bar(a) and 0°C

6) at: 1.013 bar (a) and 20°C

7) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box →

In case of special application conditions,
please consult for advice.

Subject to alteration.
© Christian Bürkert GmbH & Co. KG

1212/4_EU_en_00891971

Mass Flow Meter (MFM) for Gases



Type 8705 can be combined with...



Type 8619

Multichannel
program controller



Type 0330

3/2 or 2/2-
way solenoid valve



Type 6013

2/2-way
solenoid valve

- Bypass MFC with capillary technology for nominal flow rates from 5 ml_N/min to 15 l_N/min
- Applicable for aggressive gases
- Compact design and digital communication

Mass flow meters are used in process technology for the direct measurement of the mass flow of gases. In case of volumetric flow meters, it is necessary to measure the temperature and the pressure either the density, because gases change their density or rather their volume depending on the pressure. The measurement of the mass flow, on the other hand, is independent of the pressure and the temperature.

The digital mass flow meter Type 8705 uses a classic bypass sensor (see the description on page 2). The actual flow can be read out digitally over RS-communication. Type 8705 can optionally be calibrated for two different gases, the user can switch between these two gases.

The materials of the parts that come into contact with the medium are selected according to customer specification so that the unit can be operated with the complete range of standard process gases.

| Technical data | | | |
|---|---|--|---|
| Full scale range¹⁾ (Q _{nom}) | 5 to 15000 ml _N /min ²⁾ N ₂ equivalent | Electr. connection | D-Sub plug 9-pin |
| Control range | 1:50 | Power supply | 24V DC |
| Operating gases | Neutral, or aggressive gases | Voltage tolerance | ±10 % |
| Calibration gas | Operating gas or air with conversion factor | Residual ripple | <2 % |
| Max. operating pressure (Inlet pressure) | 10 bar (145 psi) | Power consumption | Max. 2.5 W |
| Medium temperature | -10 to +70°C (-10 to +60°C for oxygen) | Communication | Digital via RS485 (half duplex or full duplex), RS422, RS232 with adapter |
| Ambient temperature | -10 to +50°C ³⁾ , others on request | Protection class | IP40 |
| Accuracy | ±1.5% o.R. ±0.3% F.S. (after 30min. heating period) | Dimensions [mm] | See drawings on page 5 |
| Repeatability | ±0.1% F.S. | Total weight | ca. 850 g (stainless steel) |
| Response time (t_{95%}) | <3 s | Mounting position | Horizontal or vertical |
| Materials | Body: Stainless steel Housing: PC (Polycarbonate) or metal Seals: FKM, EPDM or FFKM | Light emitting diode display (default, other allocations possible) | Indication for Power, Limit Error |
| Port connections | NPT 1/4, G 1/4, Screw-in fitting or sub-base, others on request | Binary input (default, other functions possible) | Two 1. Not assigned 2. Not assigned |
| | | Binary output (default, other functions possible) | One relay-output for Limit (process value close to full scale value) Max. load: 25V, 1A, 25VA |


¹⁾ The nominal flow value is the max. flow value calibrated which can be controlled. The nominal flow range defines the range of nominal flow rates (full scale values) possible.

²⁾ Index N: Flow rates referred to 1.013 bar and 0° C.

Alternatively there is an Index S available which refers to 1.013 bar and 20° C

³⁾ Higher temperatures on request

Measuring principle

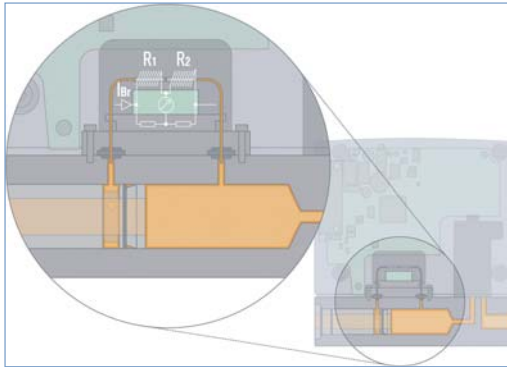

The measurement is based on the bypass principle. A laminar flow element in the main channel generates a small pressure drop. This drives a small flow, proportional to the main flow, through the bypass (sensor tube).

Two heating resistors, which are connected in a measuring bridge, are wound on this stainless steel tube. In the zero-flow state, the bridge is balanced, but with flow, heat is transported in the flow direction and the bridge becomes unbalanced.

The dynamics of the measurement is limited by the tube walls, which act as a thermal barrier. Through use of suitable software response times are obtained (in the range of a few seconds) that are adequate for a wide range of applications.

With contaminated gases we recommend to install filter elements upstream. This avoids changes in the division ratio between main flow and sensor tube, as well as

changes in the heat transmission caused by deposits on the walls of the sensor tube.

With these sensors even aggressive gases can be measured, because all essential parts in contact with the gas are fabricated in stainless steel. With this sensor principle it is also possible to convert between different gases.

$$Q(\text{Gas}) = f \times Q(\text{N}_2)$$


By using the gas factors it is possible that the accuracy is not within the datasheet specification.

| gas | factor f |
|-----------------|----------|
| N ₂ | 1.00 |
| Luft | 1.00 |
| O ₂ | 0.98 |
| H ₂ | 1.01 |
| Ar | 1.4 |
| He | 1.42 |
| CO ₂ | 0.77 |

For applications which need high accuracy it is recommended to calibrate under application conditions.

The compatibility of the sealing materials of the MFMs should be checked before use with another gas.

Pressure loss diagram (ref. to air)

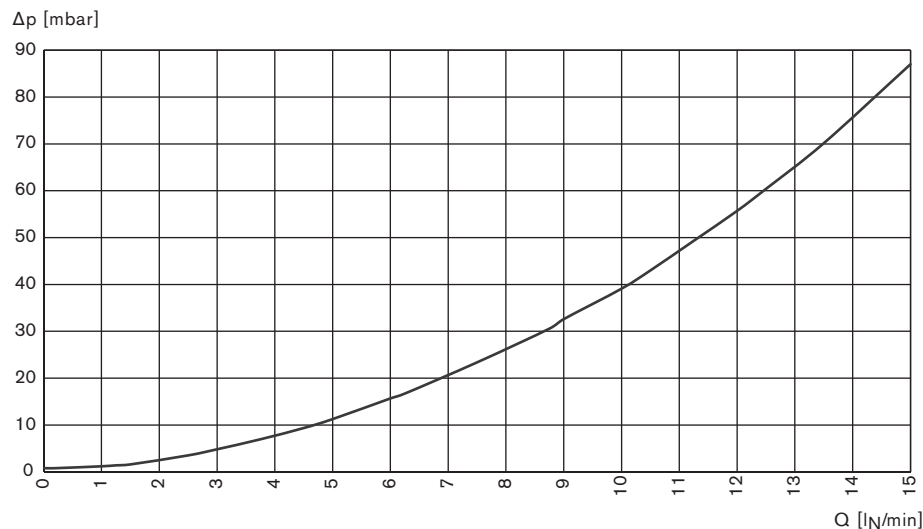

The diagram shows exemplarily the pressure loss characteristics when air flows through a flowmeter with 1/4" pipe connection. For determining the pressure loss with another gas it needs to calculate the air equivalent.

Notes regarding the selection of the unit

The decisive factors for the perfect functioning of a MFM within the application are the fluid compatibility, the normal inlet pressure and the correct choice of the flow meter range. The pressure drop over the MFM depends on the flow rate and the operating pressure.

► The request for quotation form on page 6 contains the relevant fluid specification. Please use in this way the experience of Bürkert engineers already in the design phase and provide us with a copy of the request containing the data of your application together with your inquiry or order.


Ordering table for accessories

| Article | Item no. |
|--|----------|
| 9-pin electrical connection | |
| D-Sub socket 9-pin solder connection with housing | 917 623 |
| Adapters ⁴⁾ | |
| RS232 adapter for connection with an extension cable (item N0.917 039) | 667 530 |
| Computer extension cable for RS232 9-pin socket/plug 2m | 917 039 |
| USB adapter (version 1.1, USB-socket type B) | 670 693 |
| USB cable 2m, connector type A to connector type B | 772 299 |
| Communication software "MassFlowCommunicator" | |


⁴⁾ The adapters serve mainly for initial operation or diagnosis. Those are not obligatory for continuous operation.

Software MassFlowCommunicator for Communication with Bürkert MFC/MFM

The communication software allows the user to program additionally various functions. For that purpose the MFC or MFM has to be connected to the computer by a RS232 adapter.

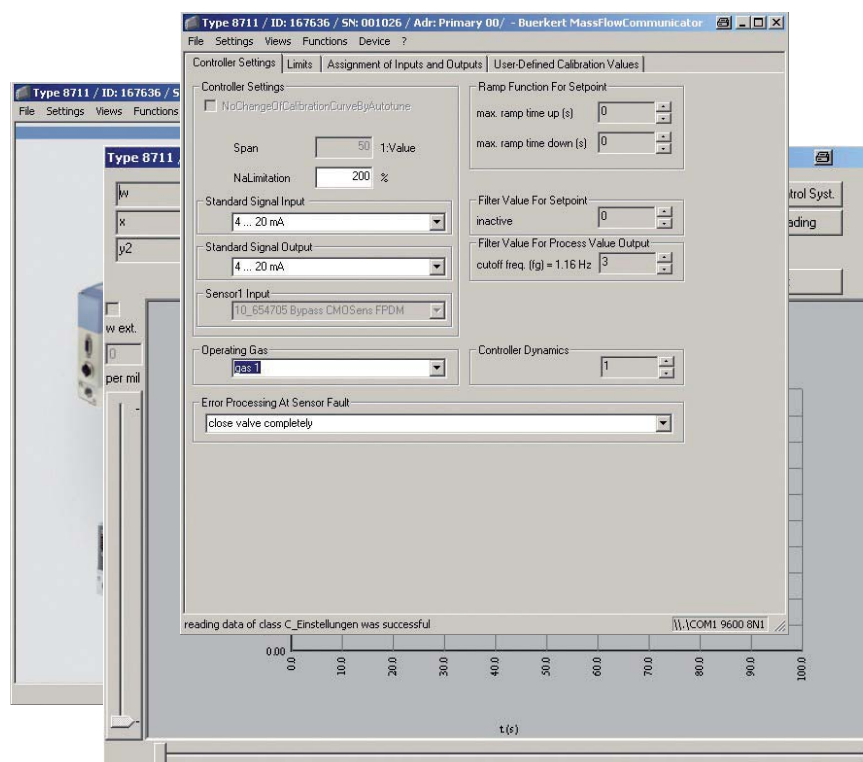


Pin Assignment

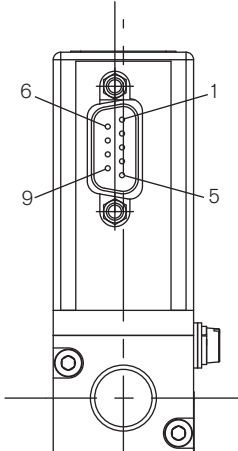


| Pin | Connection |
|-----|--|
| 1 | Binary input (related to GND Pin 2) |
| 2 | GND |
| 3 | Power supply +24V DC |
| 4 | Relay, C contact |
| 5 | Relay, NC contact |
| 6 | TX+ (RS485-Y) – bridge with pin 9 at half duplex |
| 7 | TX- (RS485-Z) – bridge with pin 8 at half duplex |
| 8 | RX- (RS485-B) |
| 9 | RX+ (RS485-A) |

Networking

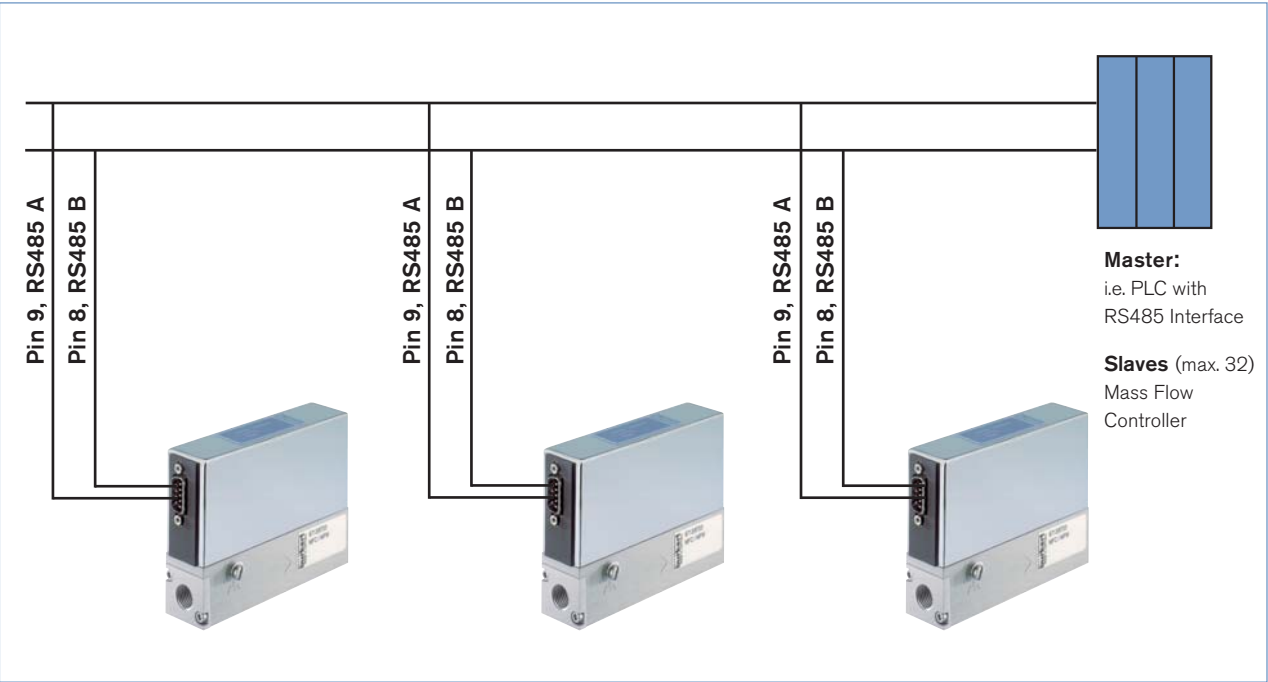


Dimensions [mm]

Threaded version

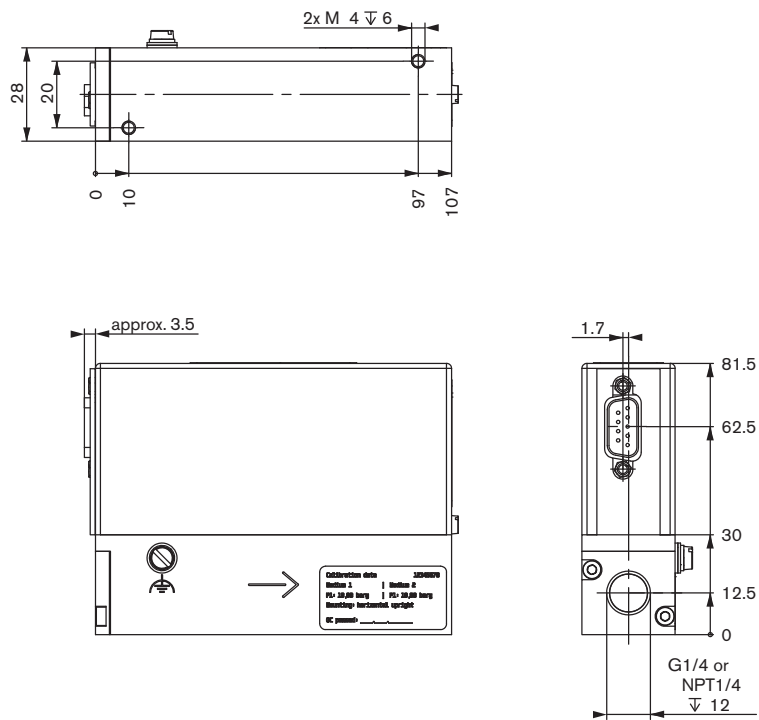

Sub-base version

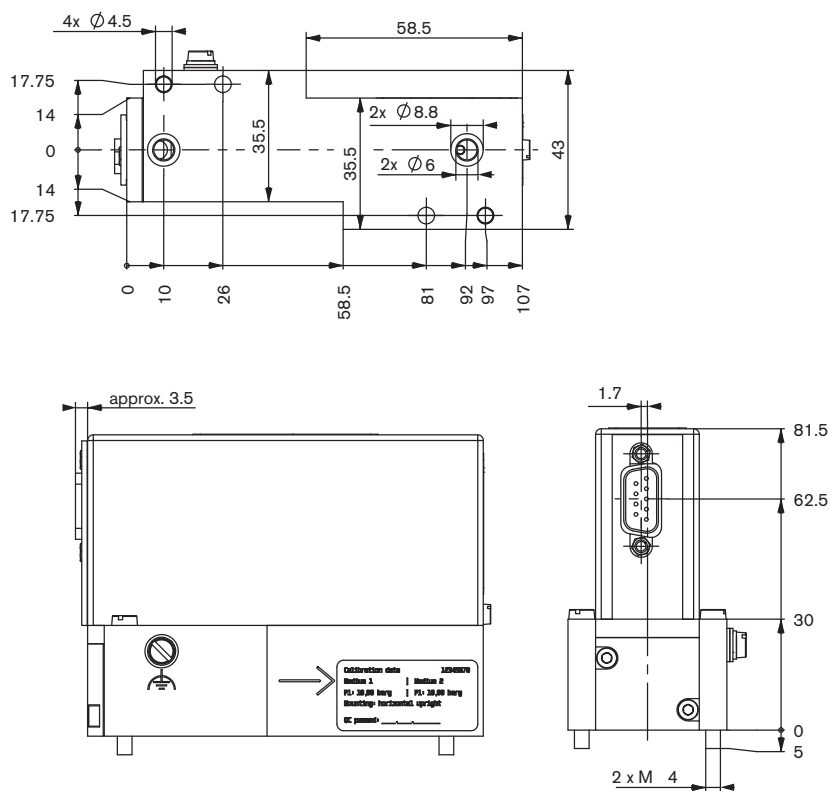

MFC/MFM-applications - Request for quotation

▶ Please complete and send to your nearest Bürkert sales centre

| | |
|---------------|----------------|
| Company | Contact person |
| Customer No | Department |
| Address | Tel./Fax |
| Postcode/Town | E-mail |

☐ MFC-Application ☐ MFM-Application Quantity Required delivery date

Medium data

Type of gas (or gas proportion in mixtures)

Density kg/m³ ⁵⁾

Gas temperature [°C or °F] °C °F

Moisture content g/m³

Abrasive components/solid particles ☐ no ☐ yes, as follows:

Fluidic data

Flow range Q_{nom} Min. ☐ l_N/min ⁵⁾ ☐ l_S/min (slpm) ⁶⁾
 Max. ☐ m_N³/h ⁵⁾ ☐ kg/h
☐ cm_N³/min ⁵⁾ ☐ cm_S³/min (scm) ⁶⁾
☐ l_N/h ⁵⁾ ☐ l_S/h ⁶⁾

Inlet pressure at Q_{nom} ⁷⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure P_{1max} bar(g) ■

MFC/MFM port connection ☐ without screw-in fitting
☐ 1/4" G-thread (DIN ISO 228/1)
☐ 1/4" NPT-thread (ANSI B1.2)
☐ with screw-in fitting (acc. to specification for pipeline)
 mm pipeline (external Ø)
 inch pipeline (external Ø)
☐ Flange version

Installation ☐ horizontal
☐ vertical, flow upwards ☐ vertical, flow downwards

Ambient temperature °C

Material data

Body ☐ Aluminium ☐ Stainless steel

Seal ☐ FKM ☐ EPDM

■ Please quote all pressure values as overpressures with respect to atmospheric pressure bar(ü)

5) at: 1,013 bar(a) and 0°C

6) at: 1.013 bar (a) and 20°C

7) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box →


In case of special application conditions,
please consult for advice.Subject to alteration.
© Christian Bürkert GmbH & Co. KG

1307/0_EU-en_00895248

Mass Flow Controller (MFC) for Gases



Type 8713 can be combined with...

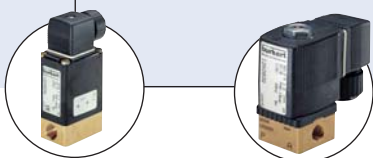

Typ 0330

3/2 or 2/2-way
valve

Typ 6013

2/2-way valve

- Direct flow measurement by MEMS- Technology for nominal flow rates from 10 ml_N/min to 80 l_N/min (N₂)
- High accuracy and repeatability
- Short settling time
- Compact design and digitally communication

Type 8713 controls the mass flow of gases that is relevant for most applications in process technologies. The measured value will be compared in the digital control electronics with the predefined set point according to the signal; if a control difference is present, the control value output to the proportional valve will be modified using a PI-control algorithm. Due to the fact that the sensor is directly in contact with the gas a very fast response time of the MFC is reached. In this way, the mass flow can be maintained at a fixed value or a predefined profile can be followed, regardless of

pressure variations or other changes in the system. Type 8713 can optionally be calibrated for two different gases, the user is able to switch between these two gases. As control element a direct-acting proportional valve guarantees a high sensitivity and a good control characteristics of the MFC. This instrument communicates digitally with master devices, no further A/D conversions needed.


| Technical Data | | | |
|---|---|--|--|
| Nominal flow range¹⁾ (Q _{nominal}) | 10 ml _N /min ²⁾ to 80 l _N /min (N ₂), see table on p. 2 | Electr. connection | Plug D-Sub 9-pin |
| Turn-down ratio | 1:50, higher turn-down ratio on request | Power supply | 24V DC |
| Operating gas | Neutral, non-contaminated gases, on request | Voltage tolerance | ±10% |
| Calibration gas | Operating gas or air with conversion factor | Residual ripple | < 2% |
| Max. operating pressure (Inlet pressure) | 10 bar (145 psi) depending on the orifice of the valve | Power consumption | Max. 11.5 W (depending on control valve used) |
| Gas temperature | -10 to +70°C (-10 to +60°C with oxygen) | Communication | Digital via RS485 (half-duplex or full-duplex), RS422, RS232 via adapter |
| Ambient temperature | -10 to +50°C ³⁾ | Protection class | IP40 |
| Accuracy | ±0.8% o.R. ±0.3% F.S. (after 1 min. warm up time) | Dimensions [mm] | see drawings p. 5-6 |
| Repeatability | ±0.1% F.S. | Total weight | ca. 500 g (aluminium body) |
| Settling time (t_{95%}) | < 300 ms | Installation | horizontal or vertical |
| Materials | Body Housing Seals Aluminium or stainless steel Metal FKM, EPDM | Light emitting diodes (default functions, other functions programmable) | Indication for power, limit and error |
| Port connection | NPT 1/4, G 1/4, screw-in fitting or sub-base, others on request | Binary inputs (default functions, other functions programmable) | Two 1. Start Autotune 2. not assigned |
| Control valve Valve orifice K _{VS} value | Normally closed 0.05 to 4.0 mm 0.00006 to 0.32 m³/h | Binary output (default functions, other functions programmable) | One relay output for: 1. Limit (setpoint not reached) Max. Load: 25V, 1A, 25VA |

¹⁾ The nominal flow value is the max. flow value calibrated which can be controlled. The nominal flow range defines the range of nominal flow rates (full scale values) possible.

²⁾ Index N: Flow rates referred to 1.013 bar and 0° C.
Alternatively Index S which refers to 1.013 bar and 20° C

³⁾ Higher temperature on request.

Measurement principle

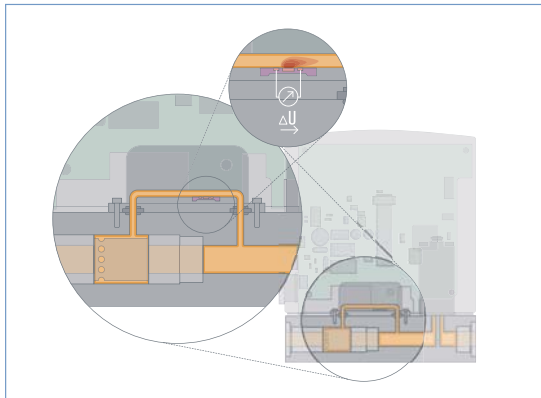

The actual flow rate is detected by a sensor. This operates according to a thermal principle which has the advantage of delivering the mass flow without any corrections for the required pressure or temperature.

A small part of the total gas stream is diverted into a small, specifically designed bypass channel, that ensures laminar flow conditions. The sensor element is a chip immersed into the wall of this channel. The chip contains a heating resistor and two temperature sensors (thermopiles) which are arranged symmetrically upstream and downstream of the heater. The differential voltage of the thermopiles is a measure of the mass flow rate passing this bypass channel. The calibration procedure effectuates a unique assignment of the sensor signal to the total flow rate passing the device.

Nominal Flow Range of Typical Gases

(other gases on request)

| Gas | Min. Q_{Nom} [l _N /min] | Max. Q_{Nom} [l _N /min] |
|----------------|---|---|
| Argon | 0.01 | 80 |
| Helium | 0.01 | 500 |
| Carbon dioxide | 0.02 | 40 |
| Air | 0.01 | 80 |
| Methane | 0.01 | 80 |
| Oxygen | 0.01 | 80 |
| Nitrogen | 0.01 | 80 |
| Hydrogen | 0.01 | 500 |

Notes regarding the selection of the unit

For the proper choice of the actuator orifice within the MFC, not only the required maximum flow rate Q_{nom} , but also the pressure values *directly* before and after the MFC (p_1, p_2) at this flow rate Q_{nom} should be known. In general, these pressures are not the same as the overall inlet and outlet pressures of the whole plant, because usually there are additional flow resistors (tubing, additional shut-off valves, nozzles etc.) present both before and after the controller.

Please use the request for quotation form on p. 7 to indicate the pressures *directly* before and after the MFC. If these should be unknown or not accessible to a measurement, estimates are to be made by taking into account the approximate pressure drops over the flow resistors before and after the MFC, respectively, at a flow rate of Q_{nom} . In addition, please quote the maximum inlet pressure p_{1max} to be encountered. This data is needed to make sure the actuator is able to provide a close-tight function within all the specified modes of operation.

► The request form on page 7 contains the relevant fluid specification. Using the experience of Bürkert engineers already in the design phase provide us with a copy of the request containing the necessary data together with your inquiry or order.


Ordering table for accessories

| Article | Item no. |
|--|----------|
| 9-pin electrical connection | |
| D-Sub socket 9-pin solder connection with housing | 917 623 |
| Adapters ⁴⁾ | |
| RS232 adapter for connection with an extension cable (item NO.917 039) | 667 530 |
| Computer extension cable for RS232 9-pin socket/plug 2m | 917 039 |
| USB adapter (version 1.1, USB-socket type B) | 670 693 |
| Communication software "MassFlowCommunicator" | |


⁴⁾ The adapters serve mainly for initial operation or diagnosis. Those are not obligatory for continuous operation.

Software MassFlowCommunicator for Communication with Bürkert MFC/MFM

The communication software allows the user to program additionally various functions. For that purpose the MFC or MFM has to be connected to the computer by a RS232 adapter.

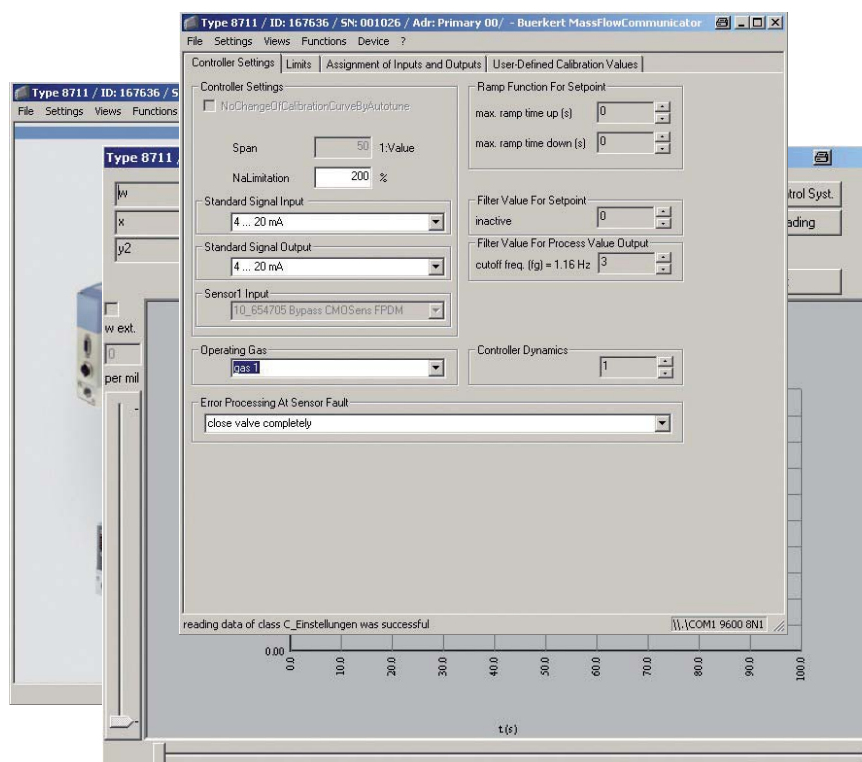


Pin Assignment

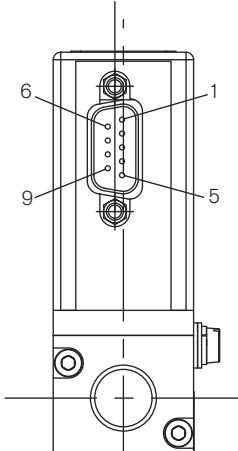

| Pin | Connection |
|-----|--|
| 1 | Binary input (related to GND Pin 2) |
| 2 | GND |
| 3 | Power supply +24V DC |
| 4 | Relay, C contact |
| 5 | Relay, NC contact |
| 6 | TX+ (RS485-Y) – bridge with pin 9 at half duplex |
| 7 | TX- (RS485-Z) – bridge with pin 8 at half duplex |
| 8 | RX- (RS485-B) |
| 9 | RX+ (RS485-A) |

Networking

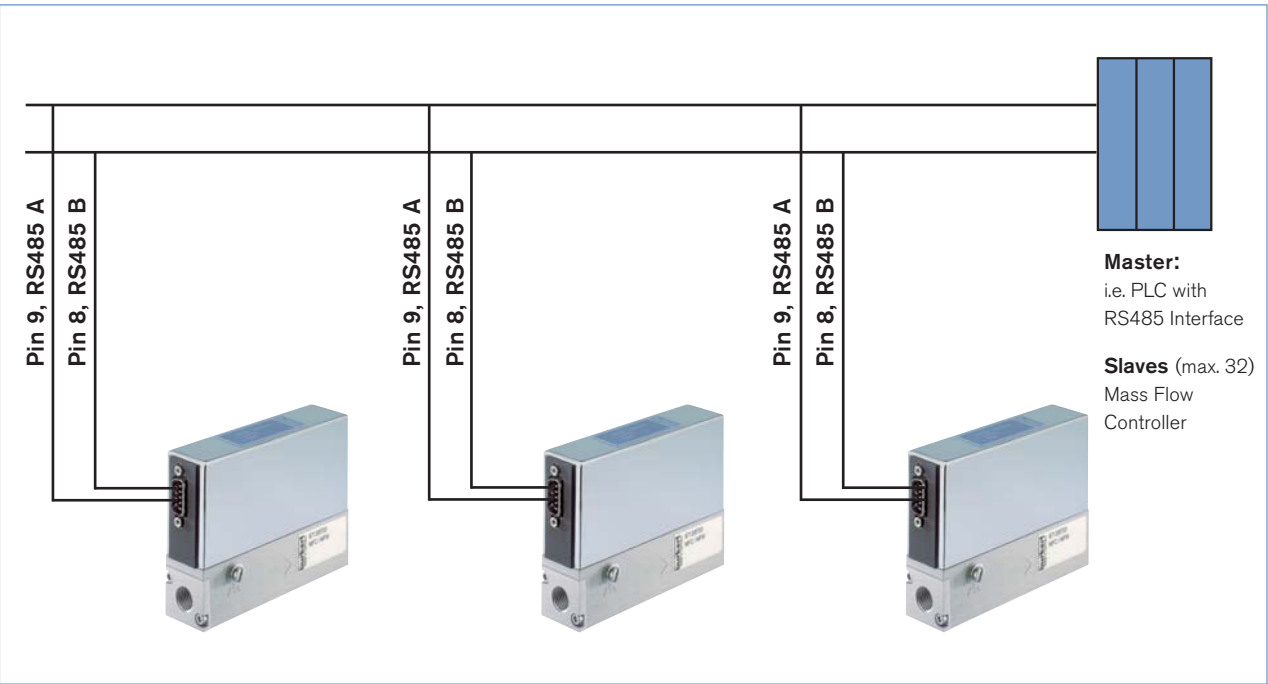

Threaded version


Technical drawings of the threaded version of the device. The top drawing is a side view showing dimensions: 28mm total height, 20mm mounting bracket height, 10mm base offset, 97mm main body length, and 107mm total length. It features two M4 screws with a 6mm pitch. The bottom left drawing is a front view showing a width of approximately 3.5mm, a pressure gauge, and a label with calibration data. The bottom right drawing is a top view showing a 1.7mm wide connector, 81.5mm and 62.5mm vertical dimensions, a 30mm base offset, 12.5mm base height, and a G1/4 or NPT1/4 thread with a 12mm pitch.

Sub-base version

Technical drawings of the sub-base version of the device. The top drawing is a side view showing dimensions: 4x Ø4.5mm mounting holes, 17.75mm total height, 14mm mounting bracket height, 0mm base offset, 14mm base height, 58.5mm main body length, 35.5mm base offset, 2x Ø8.8mm and 2x Ø6mm mounting holes, 43mm total height, and 107mm total length. The bottom left drawing is a front view showing a width of approximately 3.5mm, a pressure gauge, and a label with calibration data. The bottom right drawing is a top view showing a 1.7mm wide connector, 81.5mm and 62.5mm vertical dimensions, a 30mm base offset, 5mm base height, and 2x M4 mounting holes.

Dimensions [mm], continued

Version with external valve

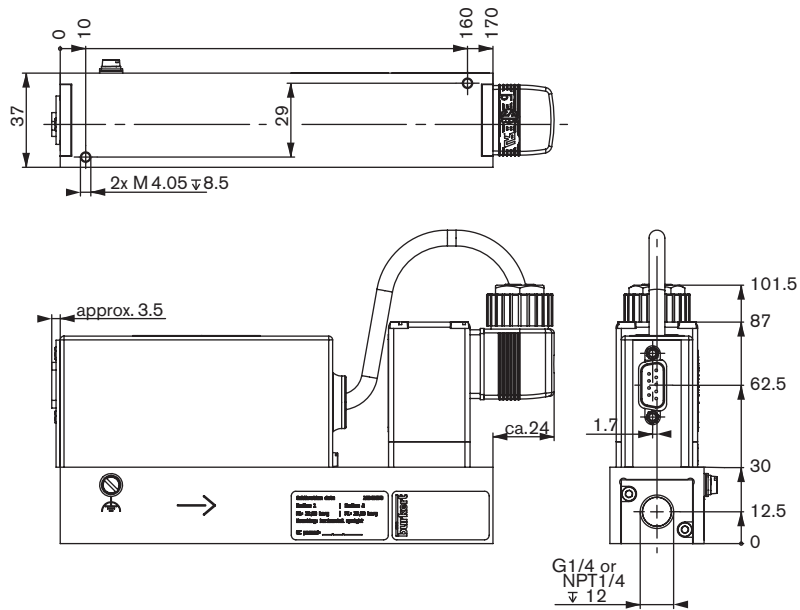

Note

You can fill out the fields directly in the PDF file before printing out the form.

MFC/MFM-applications - Request for quotation

▶ Please complete and send to your nearest Bürkert sales centre

| | |
|---------------|----------------|
| Company | Contact person |
| Customer No | Department |
| Address | Tel./Fax |
| Postcode/Town | E-mail |

☐ MFC-Application ☐ MFM-Application Quantity Required delivery date

Medium data

Type of gas (or gas proportion in mixtures)

Density kg/m³ ⁵⁾

Gas temperature [°C or °F] °C °F

Moisture content g/m³

Abrasive components/solid particles ☐ no ☐ yes, as follows:

Fluidic data

Flow range Q_{nom} Min. ☐ l_N/min ⁵⁾ ☐ l_S/min (slpm) ⁶⁾
 Max. ☐ m_N³/h ⁵⁾ ☐ kg/h
☐ cm_N³/min ⁵⁾ ☐ cm_S³/min (scm) ⁶⁾
☐ l_N/h ⁵⁾ ☐ l_S/h ⁶⁾

Inlet pressure at Q_{nom} ⁷⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure P_{1max} bar(g) ■

MFC/MFM port connection ☐ without screw-in fitting
☐ 1/4" G-thread (DIN ISO 228/1)
☐ 1/4" NPT-thread (ANSI B1.2)
☐ with screw-in fitting (acc. to specification for pipeline)
 mm pipeline (external Ø)
 inch pipeline (external Ø)
☐ Flange version

Installation ☐ horizontal
☐ vertical, flow upwards ☐ vertical, flow downwards

Ambient temperature °C

Material data

Body ☐ Aluminium ☐ Stainless steel

Seal ☐ FKM ☐ EPDM

■ Please quote all pressure values as overpressures with respect to atmospheric pressure bar(ü)

5) at: 1.013 bar(a) and 0°C

6) at: 1.013 bar (a) and 20°C

7) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box →

In case of special application conditions,
please consult for advice.

Subject to alteration.
© Christian Bürkert GmbH & Co. KG

1212/2_EU-en_00891970

Mass Flow Controller (MFC) for Gases



- Inline MFC for full scale rates from 20 l_N/min to 1500 l_N/min; 1/4" to 1"
- High accuracy
- Short settling time
- Optional fieldbus

Type 8626 can be combined with...



Type 8619

Multichannel
program controller



Type 0330

3/2-way valve



Type 6013

2/2-way valve

The Type 8626 mass flow controller forms an integrated system, consisting of the flow sensor, control electronics and control valve. Using this controller, mass flows of gases can be kept constant or can follow a predefined set-point profile regardless of interfering influences (such as pressure or temperature variations). The sensor works according to the thermal principle (constant-temperature anemometer). The measurement is made in the main channel and provides the mass flow directly without any corrections (see description on page 2). The digital flow controller compares the set point with the actual value and calculates the control signal for the proportional valve. The direct-acting solenoid control valve works according to the well-tried plunger-type principle, and is driven by a PWM voltage signal. Besides its control function an

intelligent algorithm ensures that the valve closes tight with 0% set point. The measurement in the main flow of the MFC Type 8626 is characterized by an excellent dynamics and a low sensitivity to contamination. The MFC can be used in versatile flow control tasks.

- Process technology
- Heat treatment
- Environmental technology
- Material coating
- Burner controls
- Fuel cell technology

| Technical Data | | | |
|--|--|--|--|
| Nominal flow range ¹⁾ (Q _{nom}) | 20 to 1500 l _N /min ²⁾ , N ₂ equivalent see table on page 2, higher flows on request | Port connection | G 1/4", 3/8", 1/2", 3/4", 1" NPT 1/4", 3/8", 1/2", 3/4", 1" |
| Turn-down ratio | 1:50 ³⁾ | Control valve | Normally closed |
| Operating gas | Neutral, non-contaminated gases, others available on request | Valve orifice | 0.8 to 12 mm |
| Calibration gas | Operating gas or air with correcting function | K _{vs} value | 0.02 to 2.8 m³/h |
| Max. operating pressure (inlet pressure) | Up to max. 10 bar, depending on the orifice of the valve | Electr. connection | Socket M16, round, 8-pin and socket D-Sub HD15, 15-pin |
| Gas temperature | -10 to +70°C (-10 to +60°C with oxygen) | Additionally with: | |
| Ambient temperature | -10 to +45°C (higher temperatures on request) | - PROFIBUS-DP: | Socket M12 5-pin or D-Sub 9-pin |
| Accuracy (after 15 min warm up time) | ±1.5% o.R. ±0.3% F.S. (o.R.: of reading; F.S.: of full scale) | - DeviceNet/CANopen: | Plug M12 5-pin or D-Sub 9-pin |
| Repeatability | ±0.1% F.S. | with RS485 version only: | Plug D-Sub 9-pin |
| Settling time (t _{95%}) | <500 ms | Operating voltage | 24V DC |
| Materials | | Voltage tolerance | ±10% |
| Body | Aluminium (black anodized) or stainless steel | Residual ripple | < 2% |
| Housing | Aluminium (coated) | Power consumption | 12,5 W–37 W (depending on version) |
| Seals | FKM, EPDM | Type of protection (with connected cables) | IP65 |
| | | Dimensions | See drawings on p. 6–9 |
| | | Total weight (examples) | 2,5 kg (Al, 16 W-valve) 4,5 kg (VA, 16 W-valve) |
| | | Mounting position | Horizontal or vertical |
| | | Light emitting diodes | Indication for |
| | | (Default, other functions programmable) | 1. Power, 3. Limit 2. Communication 4. Error |

¹⁾ The nominal flow value is the max. flow value calibrated which can be controlled. The nominal flow range defines the range of nominal flow rates (full scale values) possible.


²⁾ Index N: Flow rates referred to 1.013 bar and 0° C.

Alternatively there is an Index S available which refers to 1.013 bar and 20° C

³⁾ With vertical installation and flow downwards the turn-down ratio is 1:10

| Technical Data (cont.) | | | |
|--|--|---------------------------------|---|
| Device variant | Analog signal version | Fieldbus version | RS485 version (only D-Sub, 9-pin) |
| Analog communication Input signal (set point) Input impedance Output signal (actual flow) Max. current voltage output Max. load current output | 0-5 V, 0-10 V, 0-20 mA or 4-20 mA >20 kΩ (voltage) <300 Ω (current) 0-5 V, 0-10 V, 0-20 mA or 4-20 mA 10 mA 600 Ω | None | None |
| Fieldbus option (D-Sub HD15 covered with sealed plate for pins for analogue inputs/outputs not connected) | None | PROFIBUS-DP, DeviceNet, CANopen | Modbus RTU (via RS interface) |
| Digital communication via adapter possible: | RS232 (supports Modbus RTU) RS485, RS422 or USB | | RS485, RS422 USB |
| Binary inputs (Default, other functions programmable) | Three: 1. Start Autotune 2. not assigned 3. not assigned | | One: Start Autotune |
| Binary outputs (Default, other functions programmable) | Two relay outputs 1. Limit (desired value cannot be achieved) 2. Error (e.g. sensor fault) Load capacity: max. 60 V, 1 A, 60 VA | | One relay output 1. Limit (desired value cannot be achieved) Load capacity: max. 25 V, 1 A, 25 VA |

Measuring Principle

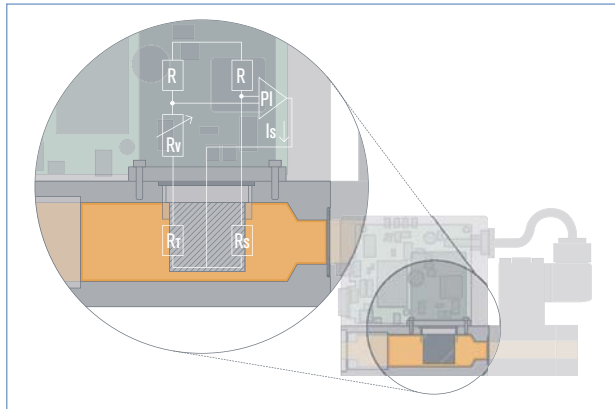

This sensor works as a hot-film anemometer in the so-called CTA operational mode (Constant Temperature Anemometer). To do this, two resistors with precisely specified temperature coefficients located directly in the media flow and three resistors located outside the flow are connected together to form a bridge.

The first resistor in the gas flow (R_T) measures the fluid temperature, while the second, low-value resistor (R_S) is heated so that it is maintained at a fixed, predefined over-temperature with respect to the fluid tem-

Nominal Flow Ranges of Typical Gases

(other gases on request)

| Gas | Min. Q_{nom} [l _N /min] | Max. Q_{nom} [l _N /min] |
|----------------|---|---|
| Acetylene | 20 | 975 |
| Ammonia | 20 | 1250 |
| Argon | 20 | 1500 |
| Carbon dioxide | 20 | 800 |
| Air | 20 | 1500 |
| Methane | 20 | 750 |
| Propane | 20 | 400 |
| Oxygen | 20 | 1500 |
| Nitrogen | 20 | 1500 |

perature. The heating current required to maintain this is a measure of the heat being removed by the flowing gas, and represents the primary measurement.

An adequate flow conditioning within the MFC and the calibration with high-quality flow standards ensure that the mass of gas flowing per time unit can be derived from the primary signal with high accuracy.

Notes Regarding the Configuration

For the proper choice of the actuator orifice within the MFC, not only the required maximum flow rate Q_{nom} , but also the pressure values directly before and after the MFC (p_1 , p_2) at this flow rate Q_{nom} should be known. In general, these pressures are not the same as the overall inlet and outlet pressures of the whole plant, because there are usually additional flow resistors (tubing, additional shut-off valves, nozzles etc.) present both before and after the controller.

Please use the specification sheet (p. 10) to indicate the pressures directly before and after the MFC. If these should be unknown or not accessible to a measurement, estimates are to be made by taking into account the approximate pressure drops over the flow resistors before and after the MFC, respectively, at a flow rate of Q_{nom} .

In addition, please quote the maximum inlet pressure p_{1max} to be encountered. This data is needed to make sure the actuator is able to provide a close-tight function within all the specified modes of operation.


► Please use the form on page 10 for the information about your specific requirements.

Ordering Chart for Accessories


| Article | Item No. | |
|--|---|---|
| Connectors/Cables | | |
| Round plug M16 8-pin (solder connection) | 918 299 | |
| Round plug M16 8-pin with 5m cable | 787 733 | |
| Round plug M16 8-pin with 10m cable | 787 734 | |
| Plug D-Sub HD15 15-pin with 5m cable | 787 735 | |
| Plug D-Sub HD15 15-pin with 10m cable | 787 736 | |
| Adapters ⁴⁾ | | |
| RS232 adapter for connection to a computer, connection with an extension cable (item no. 917039) | 654 757 | |
| Extension cable for RS232 9-pin socket/plug 2 m | 917 039 | |
| RS422-Adapter (RS485 compatible) | 666 370 | |
| USB-Adapter for D-Sub HD15 | 670 696 | |
| USB-Adapter for D-Sub 9-pin (RS485 Version) | 670 693 | |
| USB connection cable 2 m | 772 299 | |
| Adapter for manual bus adresse settings (instad of SW) | 667 525 | |
| Software MassFlowCommunicator | Download from www.buerkert.com | |
| Accessories for Fieldbus | PROFIBUS DP (B-coded) | DeviceNet/ CANopen (A-coded) |
| M12-Plug ⁵⁾ | 918 198 | 917 115 |
| M12-socket (coupling) ⁵⁾ | 918 447 | 917 116 |
| Y-junction ⁵⁾ | 902 098 | 788 643 |
| T-junction | 918 531 | (on request) |
| Shut-off resistor | 902 553 | (on request) |
| GSD-File (PROFIBUS), EDS-File (DeviceNet, CANopen) | Download from www.buerkert.com (see Type 8626) | |

⁴⁾ The adapters serve mainly for initial operation or diagnosis. Those are not obligatory for continuous operation.

⁵⁾ The two M12 connectors as listed above cannot be used together on the same side of the Y-junction. At least one of the two M12 connection needs to be a prefabricated cable which uses typically a thinner connector.

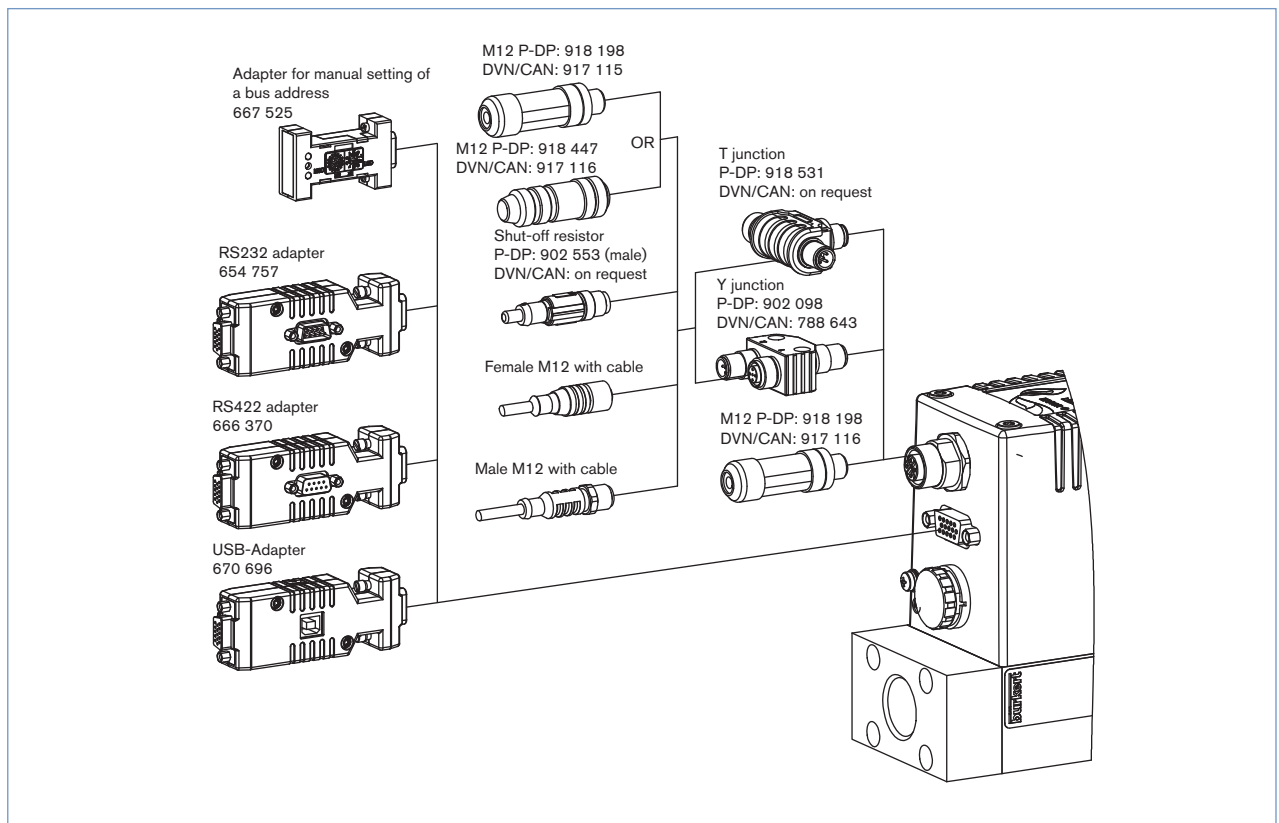


Pin Assignment

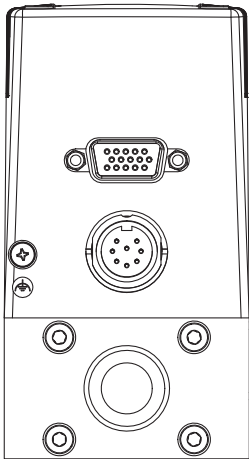

Standard

Socket D-Sub HD15

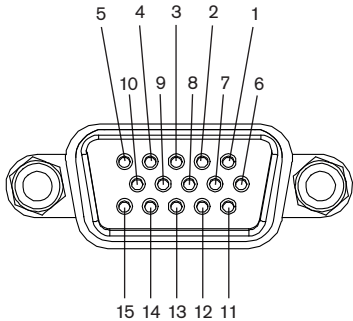


| Pin | Assignment | |
|-----|--|-------------------|
| | Analogue Control | Bus control |
| 1 | Set value input + | N.C. [®] |
| 2 | Set value input GND | N.C. |
| 3 | Actual value output + | N.C. |
| 4 | Binary input 2 | |
| 5 | 12V-Output (only for internal company use) | |
| 6 | RS232 TxD (direct connection to computer) | |
| 7 | Binary input 1 | |
| 8 | GND (for binary inputs) | |
| 9 | only company internal use (do not connect!) | |
| 10 | 12V-Output (only for internal company use) | |
| 11 | 12V-Output (only for internal company use) | |
| 12 | Binary input 3 | |
| 13 | Actual value output GND | N.C. |
| 14 | RS232 RxD (direct connection to computer) | |
| 15 | DGND (for RS232-interface) | |

[®]N.C.: not connected (not used)

Note:

- Optional Pin 1 and 2 with bus version as transmitter input possible
- The cable length for RS232/ Setpoint and flow value signal is limited to 30 meters.


Socket M16, round, 8-pin

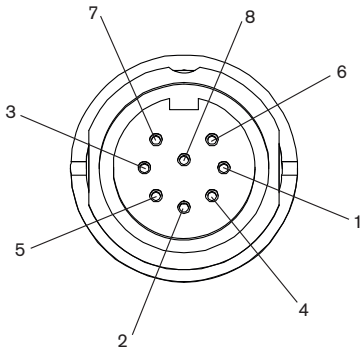


| Pin | Assignment |
|-----|-----------------------------|
| 1 | 24V-Supply + |
| 2 | Relay 1 – reference contact |
| 3 | Relay 2 – reference contact |
| 4 | Relay 1 – normally closed |
| 5 | Relay 1 – normally opened |
| 6 | 24V-Supply GND |
| 7 | Relay 2 – normally opened |
| 8 | Relay 2 – normally closed |

Socket D-Sub 9-pin

(only with fieldbus version)

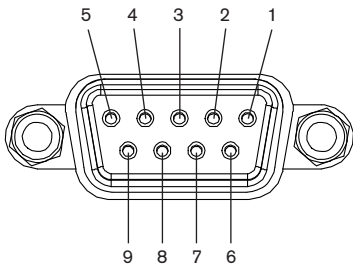


| Pin | Assignment | |
|-----|--|-----------------------|
| | PROFIBUS DP | DeviceNet/ CANopen |
| 1 | Shield | Shield |
| 2 | N.C. | CAN-L data line |
| 3 | RxD/TxD - P (B-line) | GND |
| 4 | RTS (control signal for repeater) | N.C. |
| 5 | GND | N.C. |
| 6 | VDD (only for termination resistor) | N.C. |
| 7 | N.C. | CAN-H data line |
| 8 | RxD/TxD - N (A-line) | N.C. |
| 9 | N.C. | N.C. |

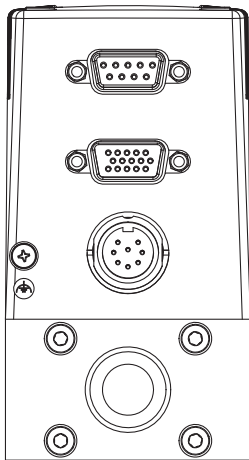


Fieldbus D-SUB


Pin Assignment (continued)

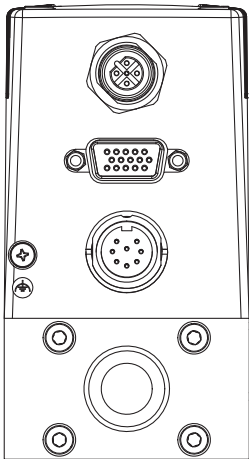


M12 Profibus

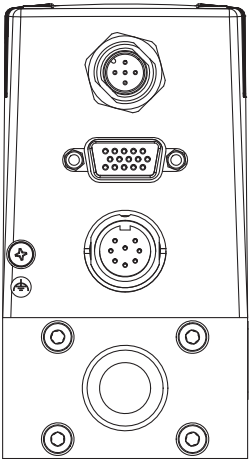


M12 DeviceNet

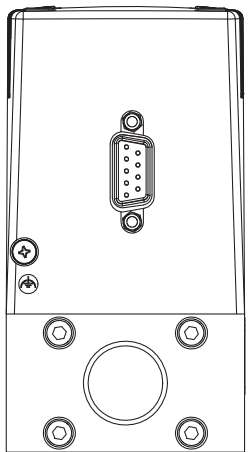


RS485 version
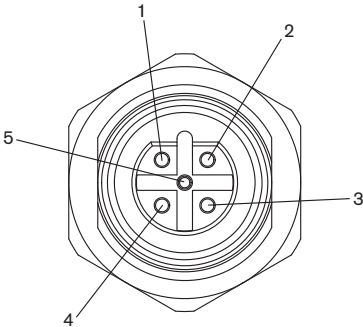
| PROFIBUS DP – socket B-coded M12 (DPV1 max. 12 Mbaud) | Pin | Assignment |
|---|-----|-------------------------------------|
|  | 1 | VDD (only for termination resistor) |
| | 2 | RxD/TxD – N (A-line) |
| | 3 | DGND |
| | 4 | RxD/TxD – P (B-line) |
| | 5 | N.C. |

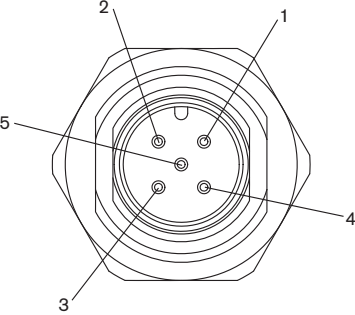
| DeviceNet/ CANopen – Plug A-coded M12 | Pin | Assignment |
|--|-----|--------------------|
|  | 1 | Shield |
| | 2 | N.C. ⁷⁾ |
| | 3 | DGND |
| | 4 | CAN_H |
| | 5 | CAN_L |

⁷⁾ Optional configuration with 24V DC possible for power supply via fieldbus connector. With this no power supply connection on round M16 plug needed.
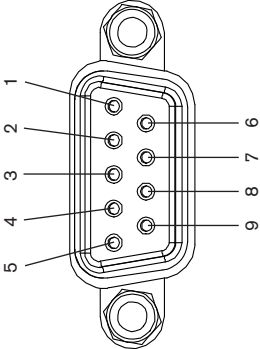
| Plug D-Sub 9-pin | Pin | Assignment |
|---|-----|--|
|  | 1 | Binary input (related to GND Pin 2) |
| | 2 | GND |
| | 3 | Power supply +24V DC |
| | 4 | Relay, normally opened |
| | 5 | Relay, normally closed |
| | 6 | TX+ (RS485-Y) – bridge with pin 9 at half duplex |
| | 7 | TX- (RS485-Z) – bridge with pin 8 at half duplex |
| | 8 | RX- (RS485-B) |
| | 9 | RX+ (RS485-A) |


Dimensions [mm]

MFC 8626 with valve type 2833 (9W coil)

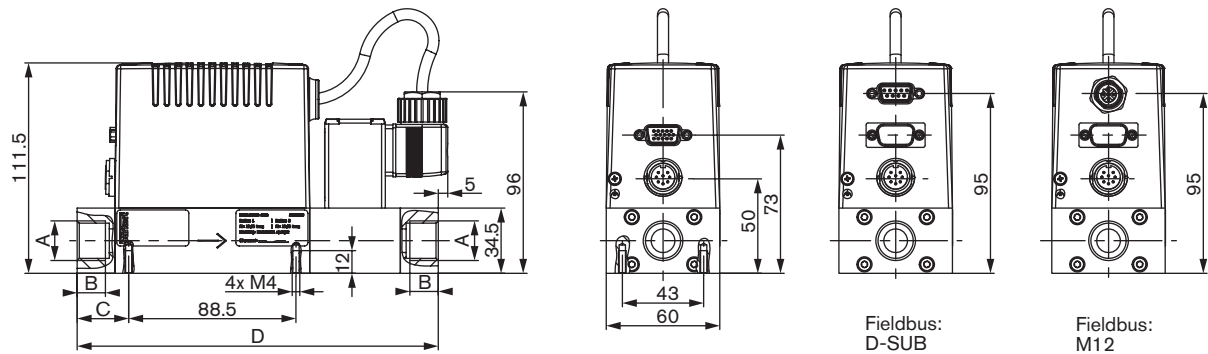

| A | B | C | D |
|----------------|----|-------|-----|
| G 1/4; NPT 1/4 | 10 | 22.25 | 181 |
| G 3/8; NPT 3/8 | 11 | 22.25 | 181 |
| G 1/2; NPT 1/2 | 14 | 27.25 | 191 |
| G 3/4; NPT 3/4 | 15 | 27.25 | 191 |


MFC 8626 with valve type 2833 (9W coil) and base block for large nominal flow rates

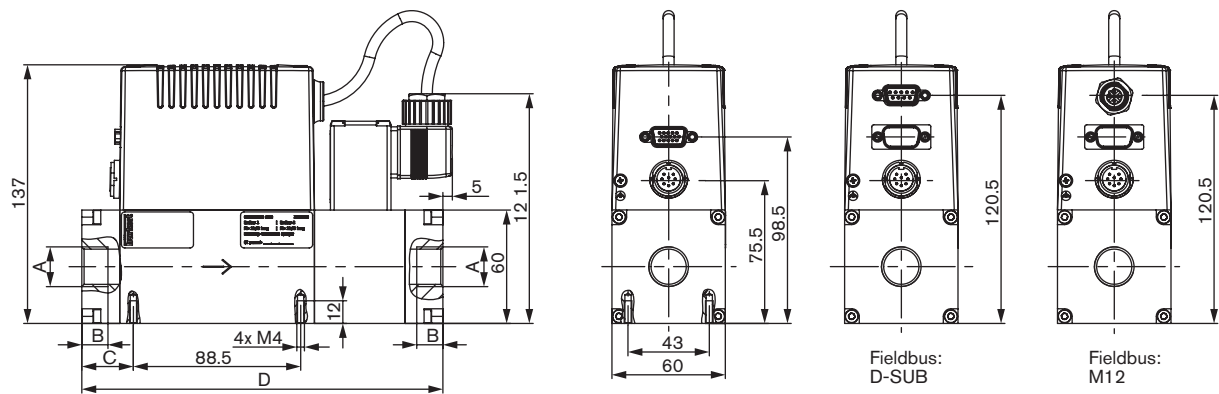

| A | B | C | D |
|----------------|----|-------|-----|
| G 3/8; NPT 3/8 | 12 | 27.25 | 191 |
| G 1/2; NPT 1/2 | 14 | 27.25 | 191 |
| G 3/4; NPT 3/4 | 15 | 27.25 | 191 |


Dimensions [mm]

MFC 8626 with valve type 2835 (16W coil)

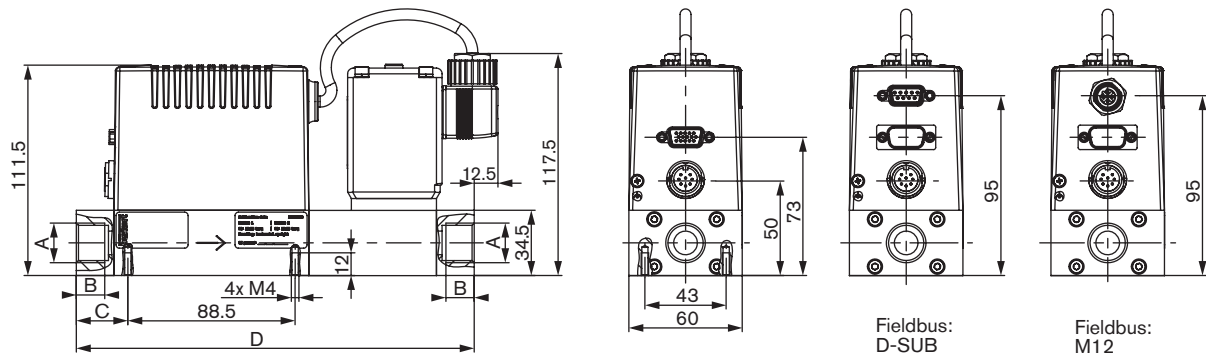

| A | B | C | D |
|----------------|----|-------|-------|
| G 1/4; NPT 1/4 | 10 | 22.25 | 200.5 |
| G 3/8; NPT 3/8 | 11 | 22.25 | 200.5 |
| G 1/2; NPT 1/2 | 14 | 27.25 | 210.5 |
| G 3/4; NPT 3/4 | 15 | 27.25 | 210.5 |


MFC 8626 with valve type 2835 (16W coil) and base block for large nominal flow rates

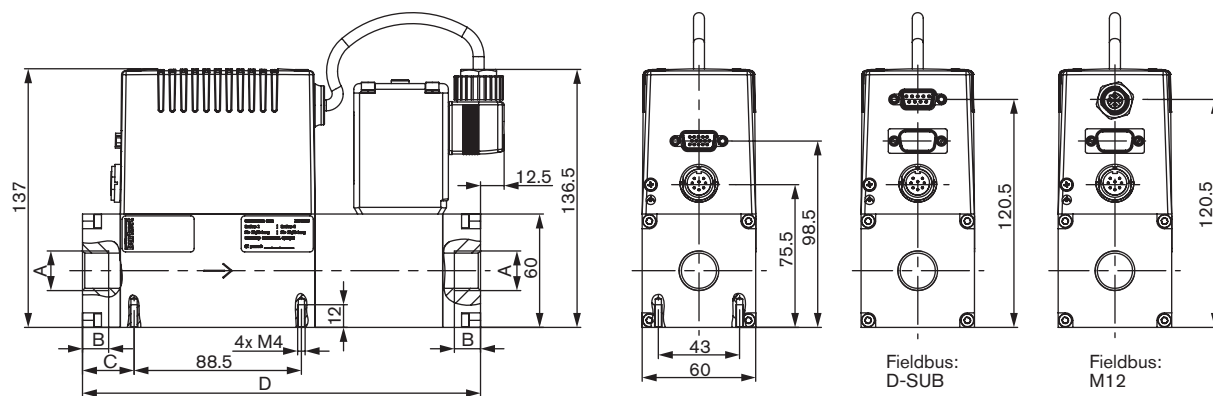

| A | B | C | D |
|----------------|----|-------|-------|
| G 3/8; NPT 3/8 | 12 | 27.25 | 210.5 |
| G 1/2; NPT 1/2 | 14 | 27.25 | 210.5 |
| G 3/4; NPT 3/4 | 15 | 27.25 | 210.5 |


Dimensions [mm]

MFC 8626 with valve type 6024 (18W coil)

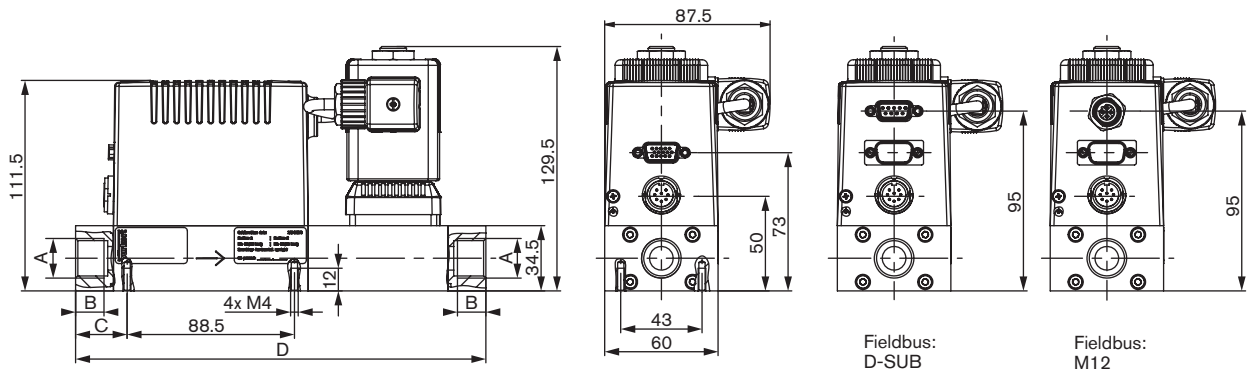

| A | B | C | D |
|----------------|----|-------|-----|
| G 1/4; NPT 1/4 | 10 | 22.25 | 207 |
| G 3/8; NPT 3/8 | 11 | 22.25 | 207 |
| G 1/2; NPT 1/2 | 14 | 27.25 | 217 |
| G 3/4; NPT 3/4 | 15 | 27.25 | 217 |


MFC 8626 with valve type 6024 (18W coil) and base block for large nominal flow rates

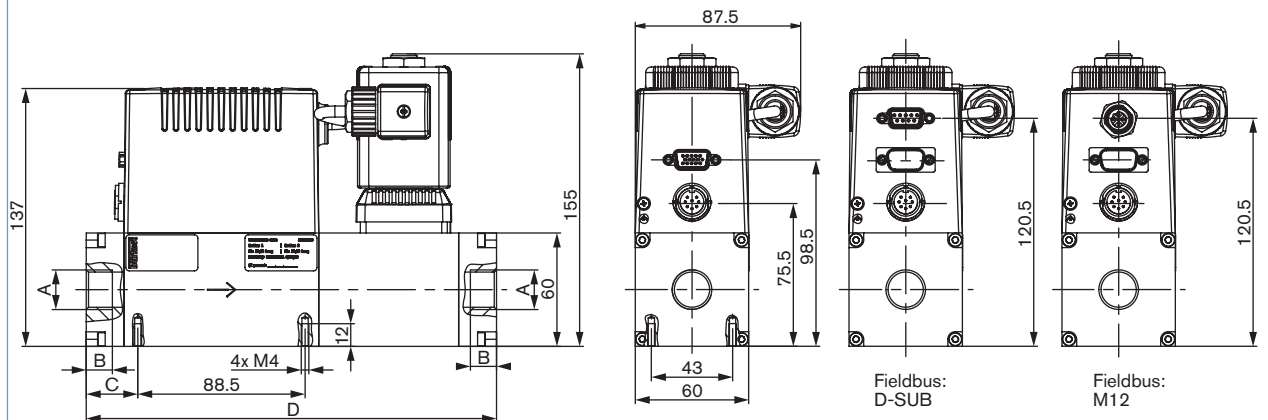


| A | B | C | D |
|----------------|----|-------|-----|
| G 3/8; NPT 3/8 | 12 | 27.25 | 217 |
| G 1/2; NPT 1/2 | 14 | 27.25 | 217 |
| G 3/4; NPT 3/4 | 15 | 27.25 | 217 |

Dimensions [mm]

MFC 8626 with valve type 2836 (24W coil)

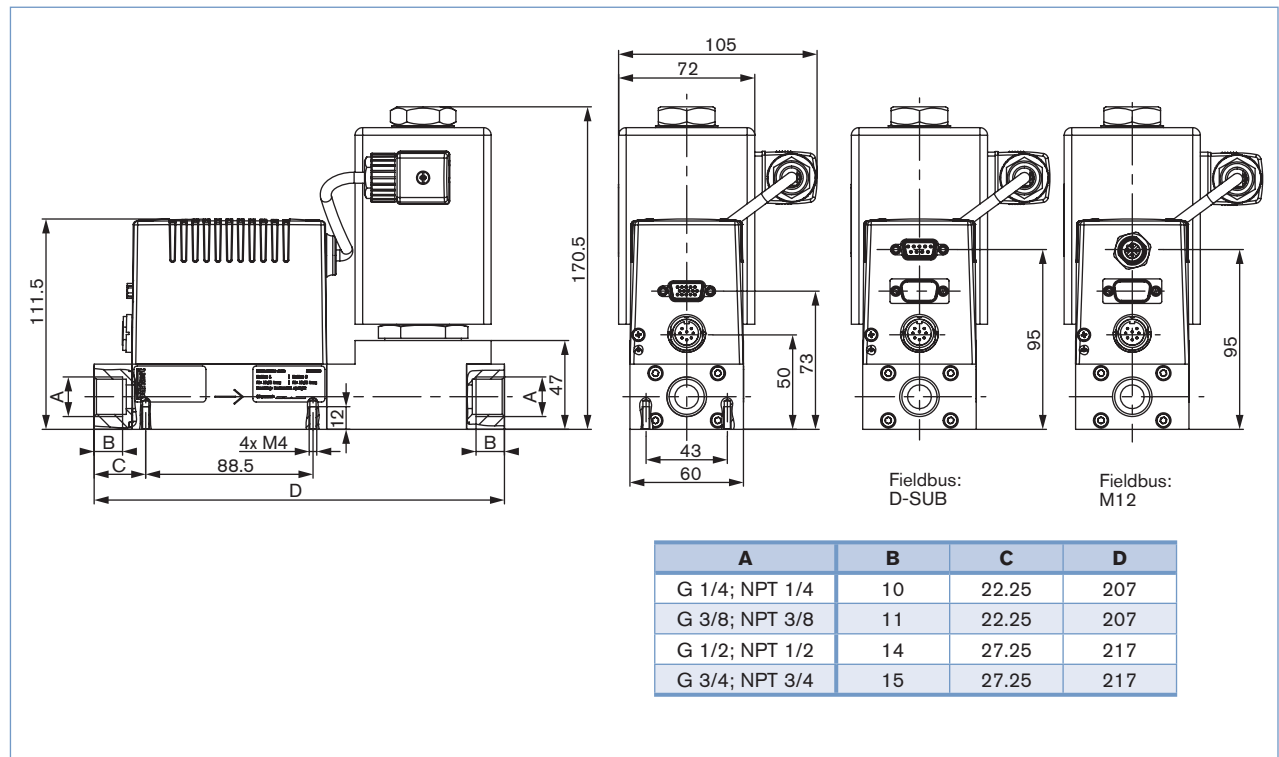

MFC 8626 with valve type 2836 (24W coil) and base block for large nominal flow rates

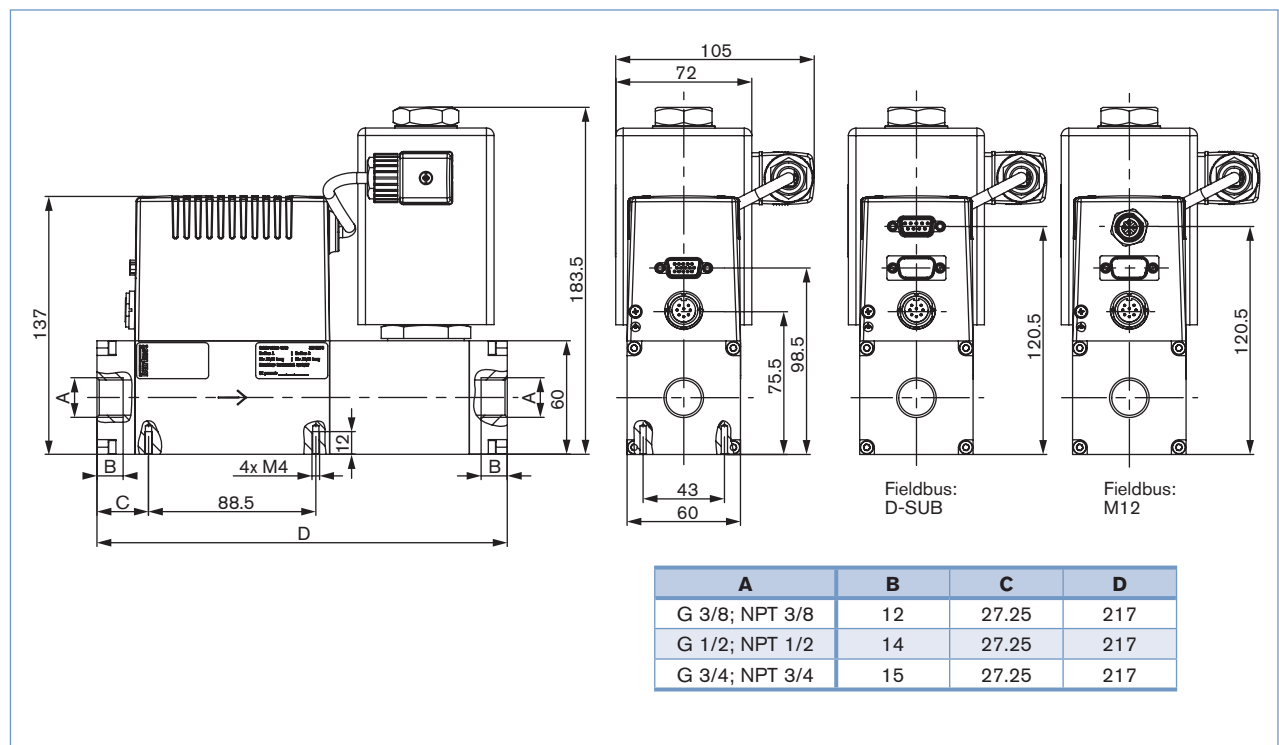

Note

You can fill out the fields directly in the PDF file before printing out the form.

MFC/MFM Applications – Request for Quotation

▶ Please complete and send to your nearest Bürkert sales centre

| | |
|---------------|----------------|
| Company | Contact person |
| Customer No | Department |
| Address | Tel./Fax |
| Postcode/Town | E-mail |

☐ MFC-Application ☐ MFM-Application Quantity Required delivery date

Fluid data

Type of gas (or gas proportion in mixtures)

Density kg/m³ ⁸⁾

Gas temperature °C °F

Moisture content g/m³

Abrasive components/solid particles ☐ no ☐ yes, as follows:

Fluidic data

Flow range Q_{nom} Min. ☐ l_N/min ⁸⁾ ☐ l_S/min (slpm) ⁹⁾
 Max. ☐ m_N³/h ⁸⁾ ☐ kg/h
☐ cm_N³/min ⁸⁾ ☐ cm_S³/min (sccm) ⁹⁾
☐ l_N/h ⁸⁾ ☐ l_S/h ⁹⁾

Inlet pressure at Q_{nom} ¹⁰⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure p_{1max} bar(g) ■

MFC/MFM port connection ☐ without screw-in fitting
☐ 1/4" G-thread (DIN ISO 228/1) ☐ 1/4" NPT-thread (ANSI B1.2)
☐ 3/8" G-thread (DIN ISO 228/1) ☐ 3/8" NPT-thread (ANSI B1.2)
☐ 1/2" G-thread (DIN ISO 228/1) ☐ 1/2" NPT-thread (ANSI B1.2)
☐ 3/4" G-thread (DIN ISO 228/1) ☐ 3/4" NPT-thread (ANSI B1.2)
☐ with screw-in fitting
 mm Pipeline (external Ø)
 inch Pipeline (external Ø)

Installation ☐ horizontal, valve upright (standard) ☐ horizontal, valve on side
☐ vertical, flow upwards ☐ vertical, flow downwards

Ambient temperature °C

Material data

Body (base block) ☐ Aluminium (anodised) ☐ Stainless steel

Seal material ☐ FKM ☐ EPDM

Electrical data

| Signals for set point and actual value | Standard signal Setpoint / Actual value | with fieldbus | with RS485 |
|---|--|---|--------------------------------|
| <input type="checkbox"/> 0-5 V <input type="checkbox"/> 0-20 mA | <input type="checkbox"/> 0-10 V <input type="checkbox"/> 4-20 mA | <input type="checkbox"/> PROFIBUS DP <input type="checkbox"/> D-Sub | <input type="checkbox"/> D-Sub |
| | | <input type="checkbox"/> DeviceNet <input type="checkbox"/> M12 | |
| | | <input type="checkbox"/> CANopen | |

■ Please quote all pressure values as overpressures with respect to atmospheric pressure [bar(ü)]

8) at: 1,013 bar(a) and 0°C

9) at: 1.013 bar (a) and 20°C

10) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box



In case of special application conditions,
please consult for advice.

Subject to alteration.
© Christian Bürkert GmbH & Co. KG

1510/6_EU-en_00891821

Mass Flow Controller (MFC) for Gases



- Bypass MFC with capillary technology for nominal flow rates from 5 ml_N/min to 15 l_N/min
- Applicable for aggressive gases
- Fieldbus option

Type 8710 can be combined with...



Type 8619

Multichannel
program controller



Type 0330

3/2 or 2/2-
way solenoid valve



Type 6013

2/2-way
solenoid valve

Type 8710 controls the mass flow of gases through a sensor element which is not in direct contact with the gas itself. The measured value provided by the sensor (see the description on page 2) will be compared in the digital control electronics with the predefined set point according to the signal; if a control difference is present, the control value output to the proportional valve will be modified using a PI control algorithm. In this way, the mass flow can be maintained at a fixed value or a predefined profile can be followed, regardless of pressure variations or other changes in the system.

The control element, a proportional valve working at low friction, guarantees a high sensitivity and a excellent control characteristics of the unit. The MassFlowCommunicator software can be used for parameterisation and diagnosis.

Typical application areas are gas dosing or rather the production of gas mixtures in:

- Heat treating,
- Melting treatment,
- Environmental technology,
- Material coating


| Technical data | | | |
|--|--|--|--|
| Full scale ranges¹⁾ (Q _{nom}) | 5 to 15000 ml _N /min ²⁾ N ₂ equivalent | Voltage tolerance | ±10 % |
| Control range | 1:50 | Residual ripple | <2 % |
| Operating gases | Neutral, or aggressive gases | Power consumption | Max. 3.5-10 W (depends on proportional valve) |
| Calibration gas | Operating gas or air with conversion factor | Input signal | 0-5 V, 0-10 V, 0-20 mA or 4-20 mA |
| Max. operating pressure (Inlet pressure) | 10 bar (145 psi), depending on the orifice of the valve | Input impedance | > 20 kΩ (voltage), < 300 Ω (current) |
| Medium temperature | -10 to +70°C (-10 to +60°C for oxygen) | Output signal | 0-5 V, 0-10 V, 0-20 mA or 4-20 mA |
| Ambient temperature | -10 to +50°C, others on request | Max. current (voltage output) | 10 mA |
| Accuracy | ±1.5% o.R. ±0.3% F.S. (after 30min. warm-up time) | Max. load (current output) | 600 Ω |
| Repeatability | ±0.1% F.S. | Digital communication via adapter possible: | RS232, Modbus RTU (via RS adapter) RS485, RS422 or USB (see accessories table on p. 3) |
| Settling time (t_{95%}) | <3 s | Fieldbus option | PROFIBUS-DP, DeviceNet, CANopen |
| Materials | | Protection class | IP40 |
| Body | Stainless steel | Dimensions [mm] | See drawings on pages 5 and 6 |
| Housing | PC (Polycarbonate) or metal | Total weight | ca. 850 g (stainless steel) |
| Seals | FKM, EPDM, FFKM | Mounting position | Horizontal or vertical |
| Port connections | NPT 1/4, G 1/4, Screw-in fitting or sub-base, others on request | Light emitting diode display (default, other allocations possible) | Indication for Power, Limit (with analog signals) / Communication (with fieldbus), Error |
| Control valve (proportional valve) | Normally closed | Binary input (default, other functions possible) | Two 1. Start autotune 2. Not assigned |
| Valve orifice | 0.05 to 2.0 mm | Binary output (default, other functions possible) | One relay-output for 1. setpoint not reached, Max. load: 25V, 1A, 25VA |
| k _{vs} -value | 0.00006 to 0.09 m³/h | | |
| Electr. connection | D-Sub plug 15-pin with PROFIBUS-DP: Socket M12 5-pin with DeviceNet, CANopen: Socket M12 5-pin | | |
| Power supply | 24V DC | | |

¹⁾ The nominal flow value is the max. flow value calibrated which can be controlled. The nominal flow range defines the range of nominal flow rates (full scale values) possible.

²⁾ Index N: Flow rates referred to 1.013 bar and 0° C.

Alternatively there is an Index S available which refers to 1.013 bar and 20° C

Measuring principle

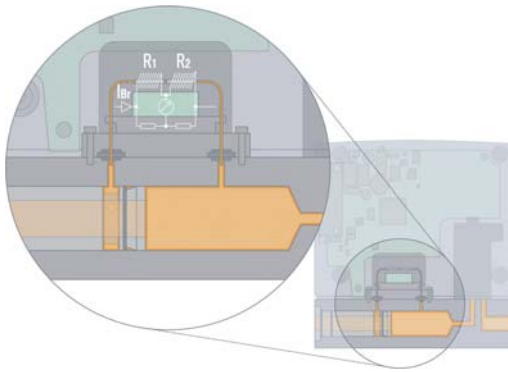

The measurement is based on the bypass principle. A laminar flow element in the main channel generates a small pressure drop. This drives a small flow, proportional to the main flow, through the bypass (sensor tube).

Two heating resistors, which are connected in a measuring bridge, are wound on this stainless steel tube. In the zero-flow state, the bridge is balanced, but with flow, heat is transported in the flow direction and the bridge becomes unbalanced.

The dynamics of the measurement is limited by the tube walls, which act as a thermal barrier. Through use of suitable software in the controller, response times are obtained (in the range of a few seconds) that are adequate for a wide range of applications.

With contaminated gases we recommend to install filter elements upstream. This avoids changes in the division ratio between main flow and sensor tube, as well as changes in the heat transmission caused by deposits on the walls of the sensor tube.

With these sensors even aggressive gases can be controlled, because all essential parts in contact with the gas are fabricated in stainless steel. With this sensor principle it is also possible to convert between different gases.

$$Q(\text{Gas}) = f \times Q(\text{N}_2)$$

| gas | factor f |
|-----------------|----------|
| N ₂ | 1.00 |
| Luft | 1.00 |
| O ₂ | 0.98 |
| H ₂ | 1.01 |
| Ar | 1.4 |
| He | 1.42 |
| CO ₂ | 0.77 |

By using the gas factors it is possible that the accuracy is not within the datasheet specification. For applications which need high accuracy it is recommended to calibrate under application conditions.

The compatibility of the sealing materials of the MFCs should be checked before use with another gas.

Notes regarding the selection of the unit

For the proper choice of the actuator orifice within the MFC, not only the required maximum flow rate Q_{nom} , but also the pressure values *directly* before and after the MFC (p_1 , p_2) at this flow rate Q_{nom} should be known. In general, these pressures are not the same as the overall inlet and outlet pressures of the whole plant, because usually there are additional flow resistors (tubing, additional shut-off valves, nozzles etc.) present both before and after the controller.

Please use the request for quotation form on p. 5 to indicate the pressures *directly* before and after the MFC. If these should be unknown or not accessible to a measurement, estimates are to be made by taking into account the approximate pressure drops over the flow resistors before and after the MFC, respectively, at a flow rate of Q_{nom} . In addition, please quote the maximum inlet pressure $p_{1\text{max}}$ to be encountered. This data is needed to make sure the actuator is able to provide a close-tight function within all the specified modes of operation.


▶ The request for quotation form on page 7 contains the relevant fluid specification. Please use in this way the experience of Bürkert engineers already in the design phase and provide us with a copy of the request containing the data of your application together with your inquiry or order.

Ordering Chart for Accessories


| Article | Item No. | |
|--|-----------------------------------|---------------------------------|
| Connections/Cables | | |
| Socket D-Sub 15-pin solder connection | 918 274 | |
| Hood for D-Sub socket, with screw locking | 918 408 | |
| Socket D-Sub 15-pin with 5m cable | 787 737 | |
| Socket D-Sub 15-pin with 10m cable | 787 738 | |
| Adapters ³⁾ | | |
| RS232 adapter | 654 748 | |
| PC extension cable for RS232 9-pin socket/plug 2 m | 917 039 | |
| RS422 adapter (RS485 compatible) | 666 371 | |
| USB adapter (Version 1.1, USB socket type B) | 670 639 | |
| USB connection cable 2 m | 772 299 | |
| Communication software MassFlowCommunicator | Download from www.buerkert.com | |
| Accessories for Fieldbus | PROFIBUS DP (B-coded) | DeviceNet, CANopen (A-coded) |
| Plug M12 ⁴⁾ | 918 198 | 917 115 |
| Socket M12 (coupling) ⁴⁾ | 918 447 | 917 116 |
| Y-junction ⁴⁾ | 902 098 | 788 643 |
| Shut-off resistor | 902 553 | (on request) |
| GSD-File (PROFIBUS), EDS-File (DeviceNet, CANopen) | Download from www.buerkert.com | |

³⁾ The adapters serve mainly for initial operation or diagnosis. Those are not obligatory for continuous operation.


⁴⁾ The two M12 connectors as listed above cannot be used together on the same side of the Y-junction. At least one of the two M12 connections needs to be a prefabricated cable which uses typically a thinner connector.

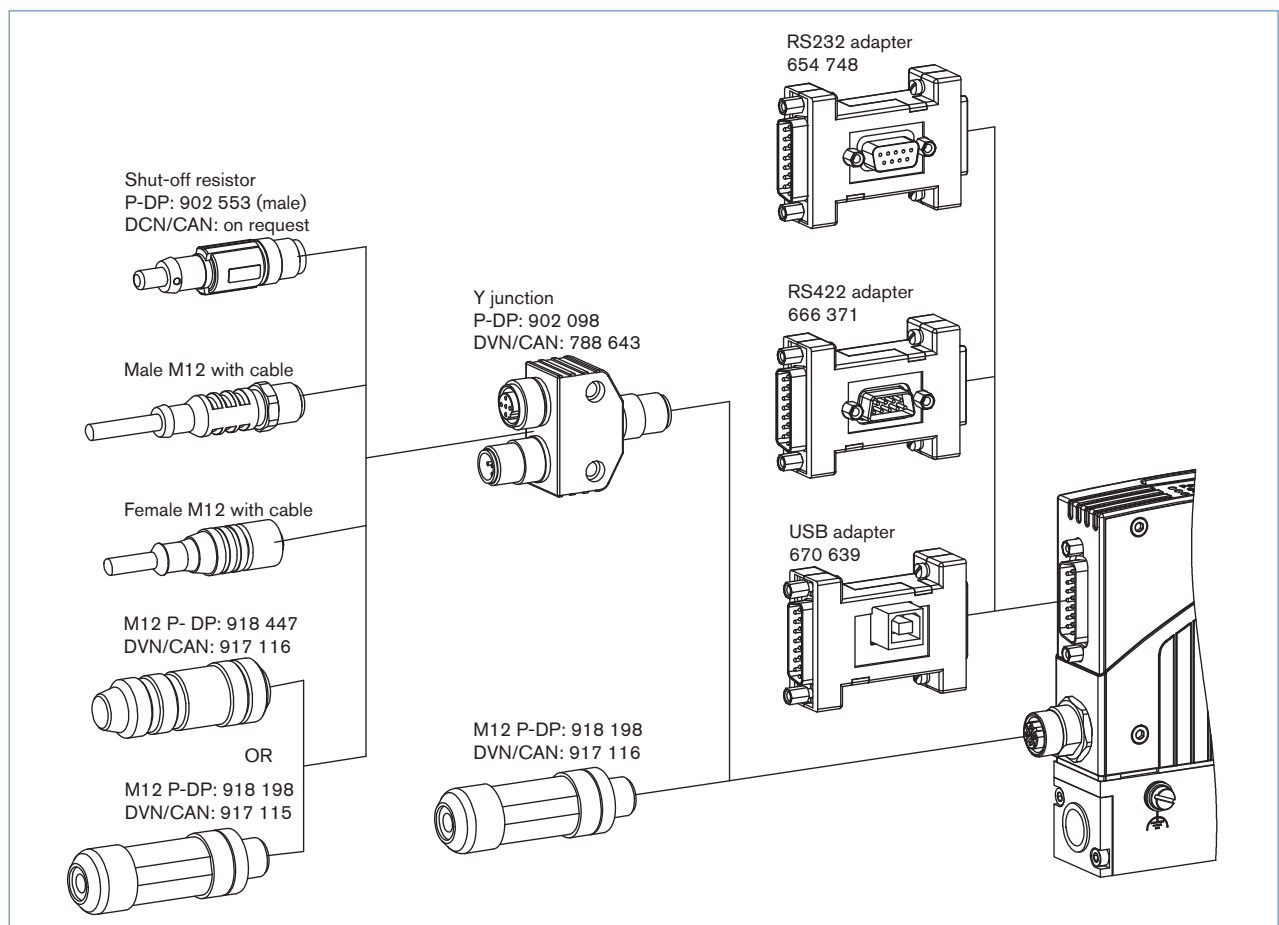

Pin Assignment

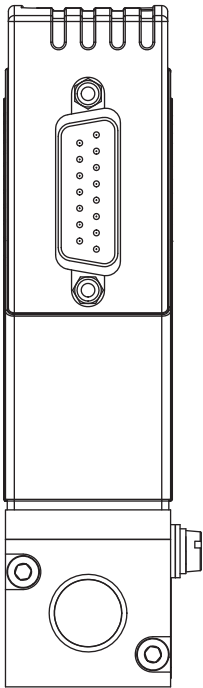

Plug D-Sub, 15-pin

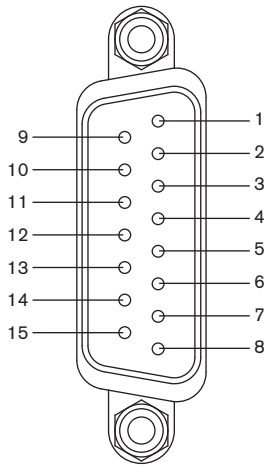


| Pin | Assignment | |
|-----|--|--------------------|
| | Analogue Control | Bus control |
| 1 | Relay – normally closed | |
| 2 | Relay – normally open | |
| 3 | Relay – middle contact | |
| 4 | GND for 24V-Supply and Binary inputs | |
| 5 | 24V-Supply + | |
| 6 | Only for internal company use | |
| 7 | Set value input GND | N.C. ⁵⁾ |
| 8 | Set value input + | N.C. |
| 9 | Actual value output GND | N.C. |
| 10 | Actual value output + | N.C. |
| 11 | DGND (for RS232) ⁶⁾ | |
| 12 | Binary input 1 | |
| 13 | Binary input 2 | |
| 14 | RS232 RxD (without driver) ⁶⁾ | |
| 15 | RS232 TxD (without driver) ⁶⁾ | |


⁵⁾ N.C.: not connected (not used)
Note:
– Optional Pin 7 and 8 with bus version as transmitter input possible
– The cable length for RS232/ Setpoint and actual value signal is limited to 30 meters.
⁶⁾ Driving RS232 interface only by RS232 adapter including an adaption of TTL levels

With Fieldbus Version:


PROFIBUS DP – socket B-coded M12 (DPV1 max. 12 Mbaud)



| Pin | Assignment |
|-----|-------------------------------------|
| 1 | VDD (only for termination resistor) |
| 2 | RxD/ TxD – N (A-Line) |
| 3 | DGND |
| 4 | RxD/ TxD – P (B-Line) |
| 5 | N.C. |

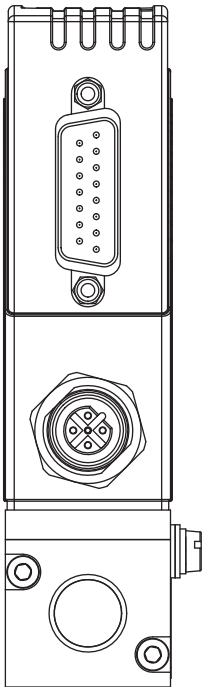


DeviceNet, CANopen – Plug M12



| Pin | Assignment |
|-----|------------|
| 1 | Shield |
| 2 | N.C. |
| 3 | DGND |
| 4 | CAN_H |
| 5 | CAN_L |


Dimensions [mm]

Standard Version

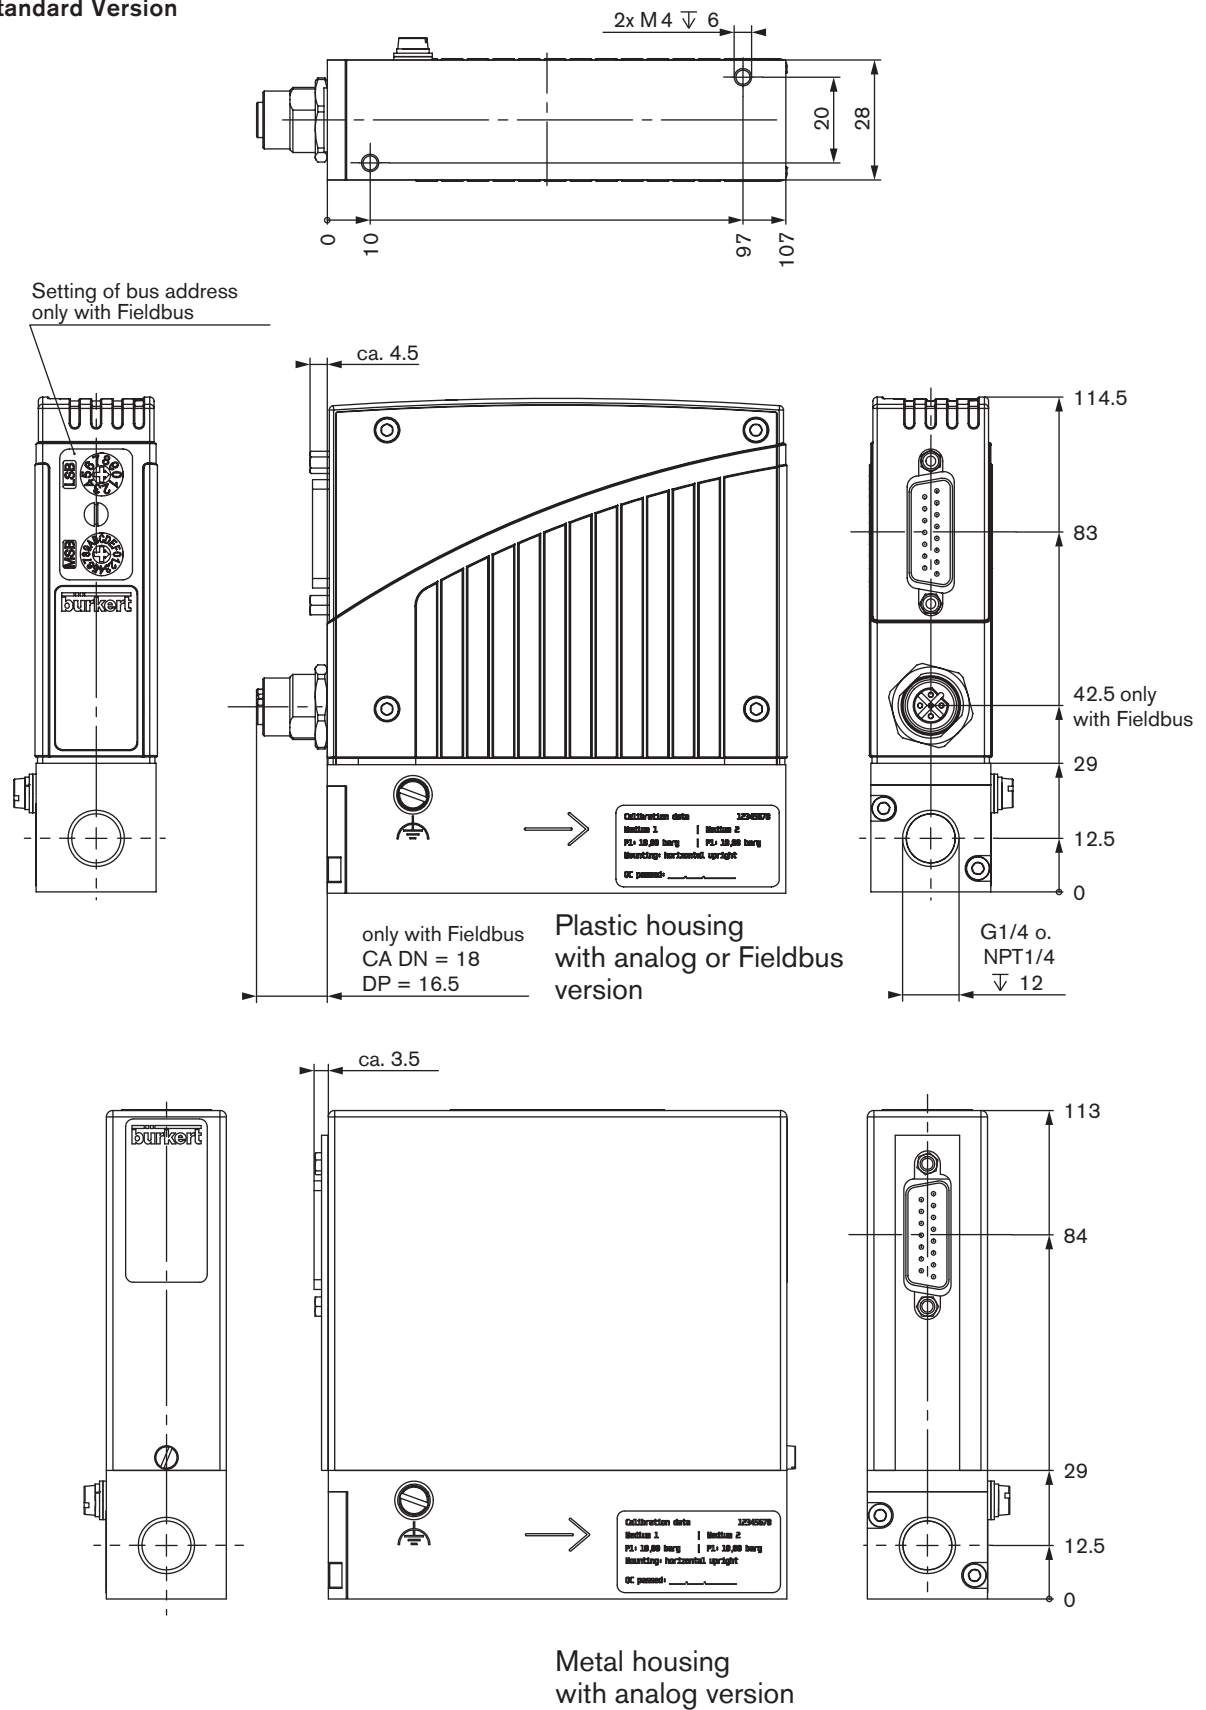

Dimensions [mm]

Subbase

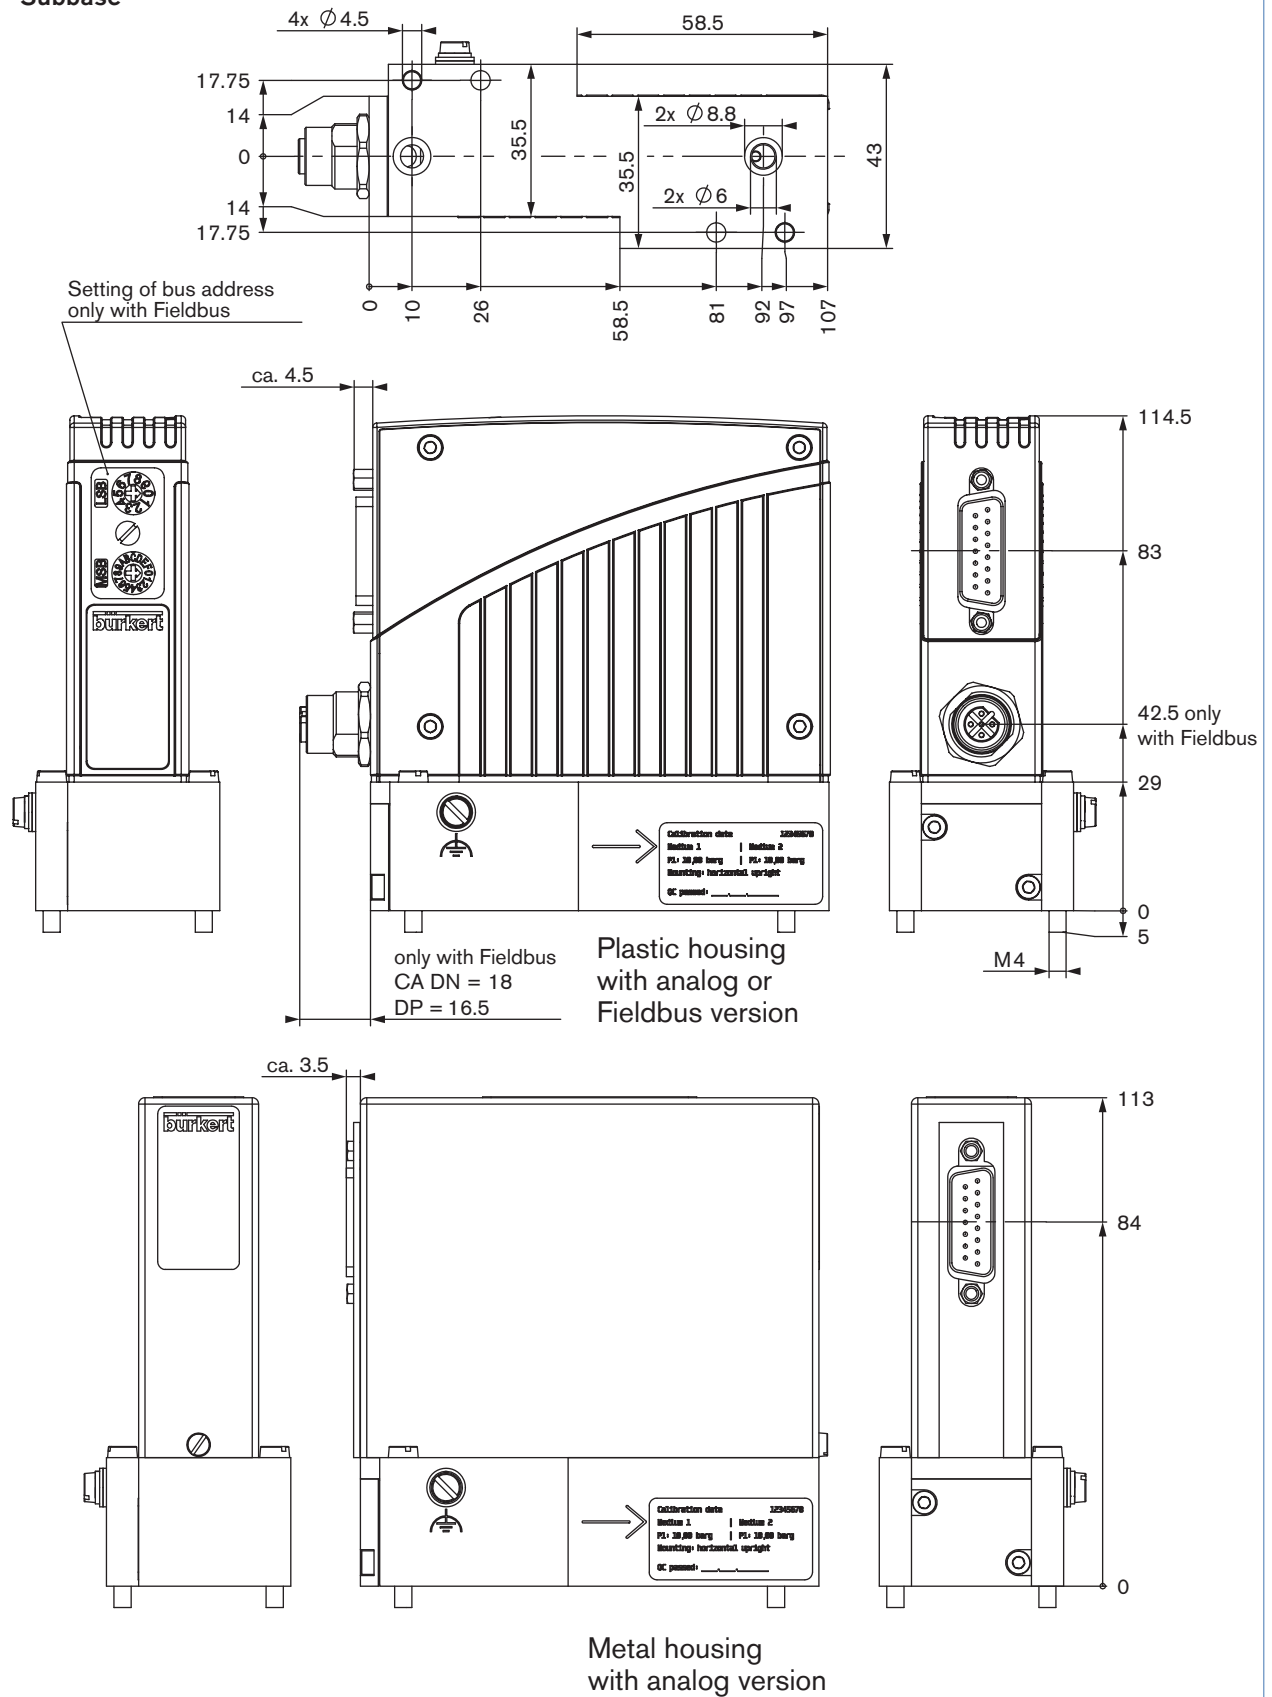

Note

You can fill out the fields directly in the PDF file before printing out the form.

MFC/MFM-applications - Request for quotation

▶ Please complete and send to your nearest Bürkert sales centre

| | |
|---------------|----------------|
| Company | Contact person |
| Customer No | Department |
| Address | Tel./Fax |
| Postcode/Town | E-mail |

☐ MFC-Application ☐ MFM-Application Quantity Required delivery date

Medium data

Type of gas (or gas proportion in mixtures)

Density kg/m³ ⁷⁾

Gas temperature [°C or °F] °C °F

Moisture content g/m³

Abrasive components/solid particles ☐ no ☐ yes, as follows:

Fluidic data

Flow range Q_{nom} Min. ☐ l_N/min ⁷⁾ ☐ l_S/min (slpm) ⁸⁾
 Max. ☐ m_N³/h ⁷⁾ ☐ kg/h
☐ cm_N³/min ⁷⁾ ☐ cm_S³/min (sccm) ⁸⁾
☐ l_N/h ⁷⁾ ☐ l_S/h ⁸⁾

Inlet pressure at Q_{nom} ⁹⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure P_{1max} bar(g) ■

MFC/MFM port connection ☐ without screw-in fitting
☐ 1/4" G-thread (DIN ISO 228/1)
☐ 1/4" NPT-thread (ANSI B1.2)
☐ with screw-in fitting (acc. to specification for pipeline)
 mm Pipeline (external Ø)
 inch Pipeline (external Ø)
☐ Flange version

Installation ☐ horizontal
☐ vertical, flow upwards ☐ vertical, flow downwards

Ambient temperature °C

Material data

Body ☐ Stainless steel

Housing ☐ Plastic ☐ Metal (not with type 8712/8702 and not with fieldbus)

Seal ☐ FKM ☐ EPDM ☐ FFKM

Electrical data

| Signals for set point and actual value | with standard signal | with fieldbus |
|--|----------------------------------|--|
| | Setpoint | actual value |
| | <input type="checkbox"/> 0-5 V | <input type="checkbox"/> 0-5 V |
| | <input type="checkbox"/> 0-10 V | <input type="checkbox"/> 0-10 V |
| | <input type="checkbox"/> 0-20 mA | <input type="checkbox"/> 0-20 mA |
| | <input type="checkbox"/> 4-20 mA | <input type="checkbox"/> 4-20 mA |
| | | <input type="checkbox"/> PROFIBUS DP <input type="checkbox"/> M12 <input type="checkbox"/> DeviceNet <input type="checkbox"/> D-Sub <input type="checkbox"/> CANopen (only for type 8712/8702) |

■ Please quote all pressure values as overpressures with respect to atmospheric pressure bar(ü)

7) at: 1,013 bar(a) and 0°C

8) at: 1.013 bar (a) and 20°C

9) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box →



In case of special application conditions, please consult for advice.

Subject to alteration
© Christian Bürkert GmbH & Co. KG

1501/4_EU-en_00891883

Mass Flow Controller (MFC) for Gases



Type 8711 can be combined with...



Type 8619

Multichannel
program controller



Type 0330

2/2 or 3/2-way
solenoid valve



Type 6013

2/2-way
solenoid valve



Type 6606

2/2 or 3/2-way
solenoid valve

- Direct flow measurement for nominal flow rates from 10 ml_N/min to 80 l_N/min (N₂) in MEMS technology
- High accuracy and repeatability
- Short settling time
- Optional fieldbus

Type 8711 controls the mass flow of gases that is relevant for most applications in process technologies. The measured value provided by the chip sensor (see the description on page 2) will be compared in the digital control electronics with the predefined set point according to the signal; if a control difference is present, the control value output to the proportional valve will be modified using a PI-control algorithm. Due to the fact that the sensor is directly in contact with the gas a very fast response time of the MFC is reached. In this way, the mass flow can be maintained at a fixed value or a predefined profile can be followed, regardless of pressure variations or other changes in the system. Type 8711 can optionally be calibrated for two different gases, the user is able to switch between these two gases.

As control element a direct-acting proportional valve guarantees a high sensitivity and a good control characteristics of the MFC. The MassFlowCommunicator software can be used for parameterisation and diagnosis. Typical application areas are gas dosing or rather the production of gas mixtures in:

- Test benches
- Bio reactors
- Heat treatment
- Material coating
- Burner controls
- Fuel cell technology


| Technical Data | | | |
|---|---|--|---|
| Nominal flow range¹⁾ (Q _{nominal}) | 10 ml _N /min ²⁾ to 80 l _N /min (N ₂), see table on p. 2 | Voltage tolerance | ±10% |
| Turn-down ratio | 1:50, higher turn-down ratio on request | Residual ripple | < 2% |
| Operating gas | Neutral, non-contaminated gases, on request | Power consumption | Max. 3.5–14 W (depending on proportional valve used) |
| Calibration gas | Operating gas or air with conversion factor | Input signal | 0–5 V, 0–10 V, 0–20 mA or 4–20 mA |
| Max. operating pressure (Inlet pressure) | 10 bar (145 psi) depending on the orifice of the valve | Input impedance | > 20 kΩ (voltage), < 300 Ω (current) |
| Gas temperature | -10 to +70°C (-10 to +60°C with oxygen) | Output signal | 0–5 V, 0–10 V, 0–20 mA or 4–20 mA |
| Ambient temperature | -10 to +50°C | Max. current (voltage) | 10 mA |
| Accuracy | ±0.8% o.R. ±0.3% F.S. (after 1 min. warm up time) | Max. load (current) | 600 Ω |
| Repeatability | ±0.1% F.S. | Digital communication | RS232, Modbus RTU (via RS adapter) via adapter possible: RS485, RS422 or USB (see accessories table on p. 3) |
| Settling time (t95%) | < 300 ms | Fieldbus option | PROFIBUS-DP, DeviceNet, CANopen |
| Materials | | Protection class | IP40 |
| Body | Aluminium or stainless steel | Dimensions [mm] | see drawings 5–7 |
| Housing | PC (Polycarbonate) or metal | Total weight | ca. 500 g (aluminium body) |
| Seals | FKM, EPDM | Installation | horizontal or vertical |
| Port connection | NPT 1/4, G 1/4, screw-in fitting or flange, others on request | Light emitting diodes (default functions, other functions programmable) | Indication for power, Limit (with analog signals) / Communication (with fieldbus) and error |
| Regulating unit (Proportional Valve) | | Binary inputs (default functions, other functions programmable) | Two 1. Start Autotune 2. not assigned |
| Valve orifice | Normally closed | Binary output (default functions, other functions programmable) | A relay output for: 1. Limit (setpoint not reached) Max. Load: 25V, 1A, 25VA |
| k _{VS} value | 0.05 to 4.0 mm 0.00006 to 0.32 m³/h | | |
| Electr. connection | Plug D-Sub 15-pin with PROFIBUS-DP: Socket M12 5-pin with DeviceNet, CANopen: Socket M12 5-pin | | |
| Power supply | 24V DC | | |

¹⁾ The nominal flow value is the max. flow value calibrated which can be controlled. The nominal flow range defines the range of nominal flow rates (full scale values) possible.

²⁾ Index N: Flow rates referred to 1.013 bar and 0° C.

Alternatively there is an Index S available which refers to 1.013 bar and 20° C

Measuring Principle

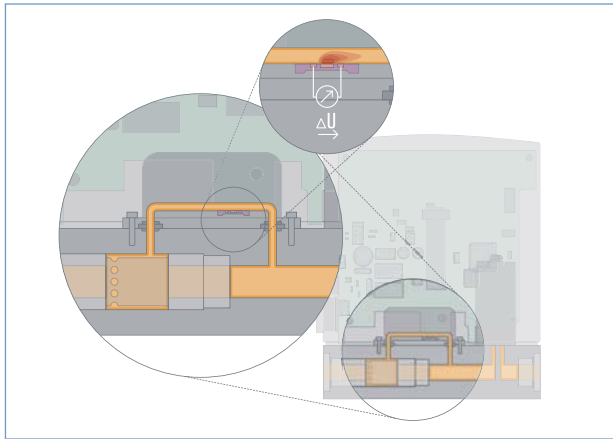

The actual flow rate is detected by a sensor. This operates according to a thermal principle which has the advantage of providing the mass flow which is independent on pressure and temperature.

A small part of the total gas stream is diverted into a small, specifically designed bypassing channel which ensures laminar flow conditions. The sensor element is a chip immersed into the wall of this flow channel. The chip, produced in MEMS technology, contains a heating resistor and two temperature sensors (thermopiles) which are arranged symmetrically upstream and downstream of the heater. The differential voltage of the thermopiles is a measure of the mass flow rate passing the flow sensor. The calibration procedure effectuates a unique assignment of the sensor signal to the total flow rate through the device.

Nominal Flow Range of Typical Gases

(other gases on request)

| Gas | Min. Q_{nom} [l _N /min] | Max. Q_{nom} [l _N /min] |
|----------------|---|---|
| Argon | 0.01 | 80 |
| Helium | 0.01 | 500 |
| Carbon dioxide | 0.02 | 40 |
| Air | 0.01 | 80 |
| Methane | 0.01 | 80 |
| Oxygen | 0.01 | 80 |
| Nitrogen | 0.01 | 80 |
| Hydrogen | 0.01 | 500 |

Notes Regarding the Configuration

For the proper choice of the actuator orifice within the MFC, not only the required maximum flow rate Q_{nom} , but also the pressure values *directly* before and after the MFC (p_1 , p_2) at this flow rate Q_{nom} should be known. In general, these pressures are not the same as the overall inlet and outlet pressures of the whole plant, because usually there are additional flow resistors (tubing, additional shut-off valves, nozzles etc.) present both before and after the controller.

Please use the request for quotation form on p. 8 to indicate the pressures *directly* before and after the MFC. If these should be unknown or not accessible to a measurement, estimates are to be made by taking into account the approximate pressure drops over the flow resistors before and after the MFC, respectively, at a flow rate of Q_{nom} . In addition, please quote the maximum inlet pressure p_{1max} to be encountered. This data is needed to make sure the actuator is able to provide a close-tight function within all the specified modes of operation.


► The request form on page 8 contains the relevant fluid specification. Using the experience of Bürkert engineers already in the design phase provide us with a copy of the request containing the necessary data together with your inquiry or order.

Ordering Chart for Accessories


| Article | Item No. | |
|--|-----------------------------------|---------------------------------|
| Connections/Cables | | |
| Socket D-Sub 15-pin solder connection | 918 274 | |
| Hood for D-Sub socket, with screw locking | 918 408 | |
| Socket D-Sub 15-pin with 5m cable | 787 737 | |
| Socket D-Sub 15-pin with 10m cable | 787 738 | |
| Adapters ³⁾ | | |
| RS232 adapter | 654 748 | |
| PC extension cable for RS232 9-pin socket/plug 2 m | 917 039 | |
| RS422 adapter (RS485 compatible) | 666 371 | |
| USB adapter (Version 1.1, USB socket type B) | 670 639 | |
| USB connection cable 2 m | 772 299 | |
| Communication software MassFlowCommunicator | Download from www.buerkert.com | |
| Accessories for Fieldbus | PROFIBUS DP (B-coded) | DeviceNet, CANopen (A-coded) |
| Plug M12 ⁴⁾ | 918 198 | 917 115 |
| Socket M12 (coupling) ⁴⁾ | 918 447 | 917 116 |
| Y-junction ⁴⁾ | 902 098 | 788 643 |
| Shut-off resistor | 902 553 | (on request) |
| GSD-File (PROFIBUS), EDS-File (DeviceNet, CANopen) | Download from www.buerkert.com | |

³⁾ The adapters serve mainly for initial operation or diagnosis. Those are not obligatory for continuous operation.


⁴⁾ The two M12 connectors as listed above cannot be used together on the same side of the Y-junction. At least one of the two M12 connection needs to be a prefabricated cable which uses typically a thinner connector.

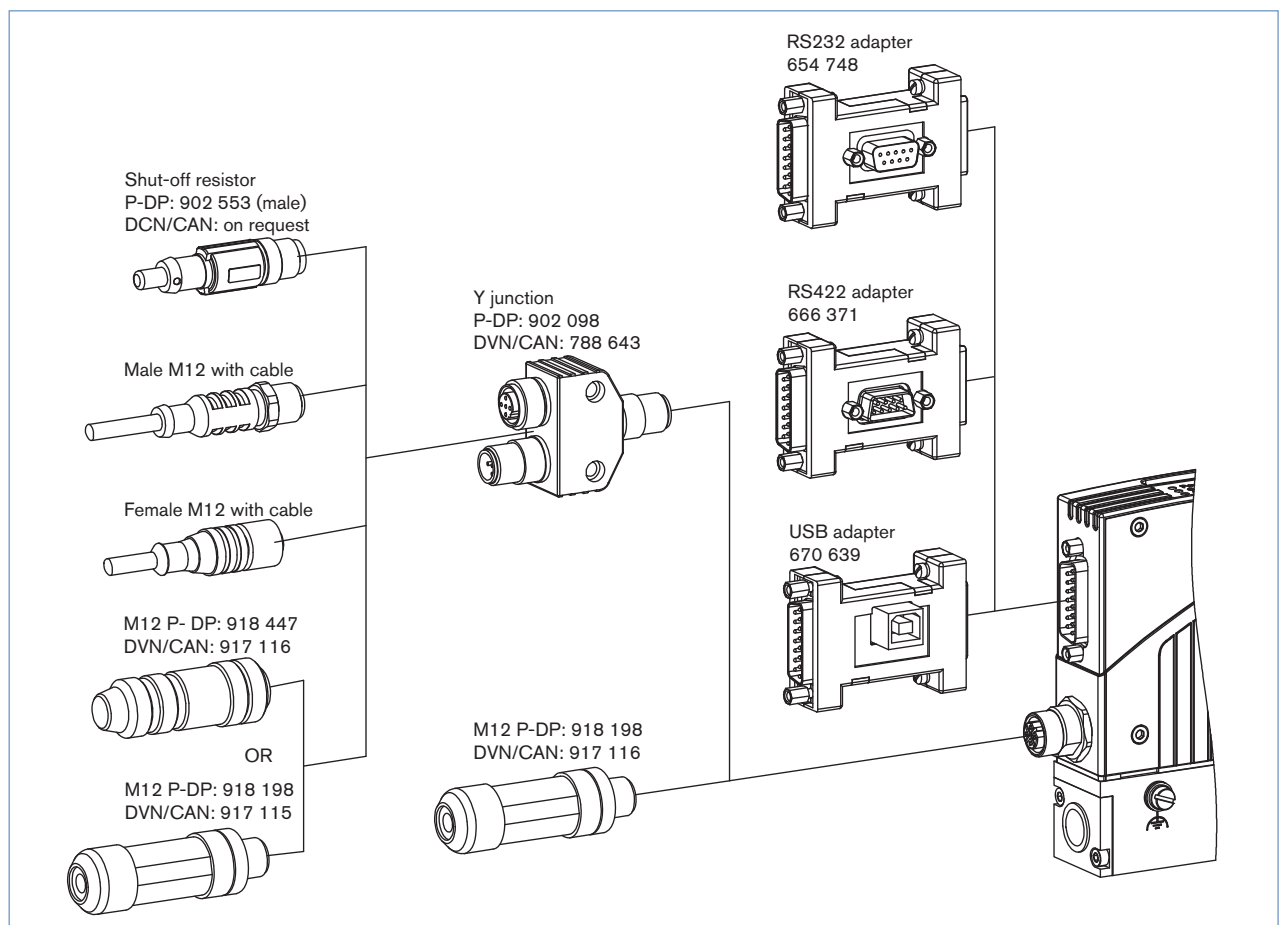

Pin Assignment

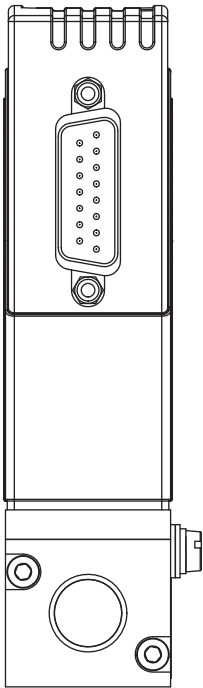

Plug D-Sub, 15-pin

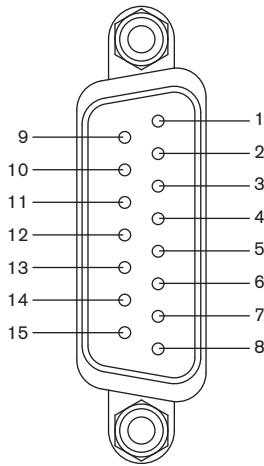

| Pin | Assignment | |
|-----|---|--------------------|
| | Analogue Control | Bus control |
| 1 | Relay – normally closed | |
| 2 | Relay – normally opened | |
| 3 | Relay – middle contact | |
| 4 | GND for 24V-Supply and Binary inputs | |
| 5 | 24V-Supply + | |
| 6 | 12V-Output (only for internal company use) | |
| 7 | Set value input GND | N.C. ⁵⁾ |
| 8 | Set value input + | N.C. |
| 9 | Actual value output GND | N.C. |
| 10 | Actual value output + | N.C. |
| 11 | DGND (for RS232) ⁶⁾ | |
| 12 | Binary input 1 | |
| 13 | Binary input 2 | |
| 14 | RS232 RxD (without driver) ⁶⁾ | |
| 15 | RS232 TxD (without driver) ⁶⁾ | |

⁵⁾ N.C.: not connected (not used)


Note:

- Optional Pin 7 and 8 with bus version as transmitter input possible
- The cable length for RS232/ Setpoint and actual value signal is limited to 30 meters.


⁶⁾ Driving RS232 interface only by RS232 adapter including an adaption of TTL levels

With Fieldbus Version:


PROFIBUS DP – socket B-coded M12 (DPV1 max. 12 Mbaud)



| Pin | Assignment |
|-----|-------------------------------------|
| 1 | VDD (only for termination resistor) |
| 2 | RxD/ TxD – N (A-Line) |
| 3 | DGND |
| 4 | RxD/ TxD – P (B-Line) |
| 5 | C (4) |

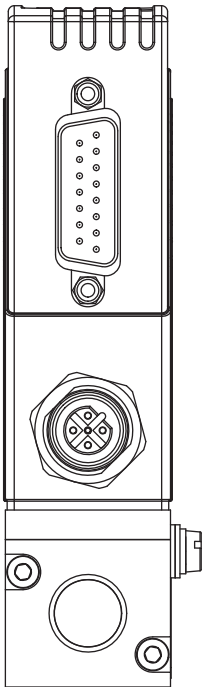


DeviceNet, CANopen – Plug M12



| Pin | Assignment |
|-----|--------------------|
| 1 | Shield |
| 2 | N.C. ⁷⁾ |
| 3 | DGND |
| 4 | CAN_H |
| 5 | CAN_L |


Dimensions [mm]

Standard Version

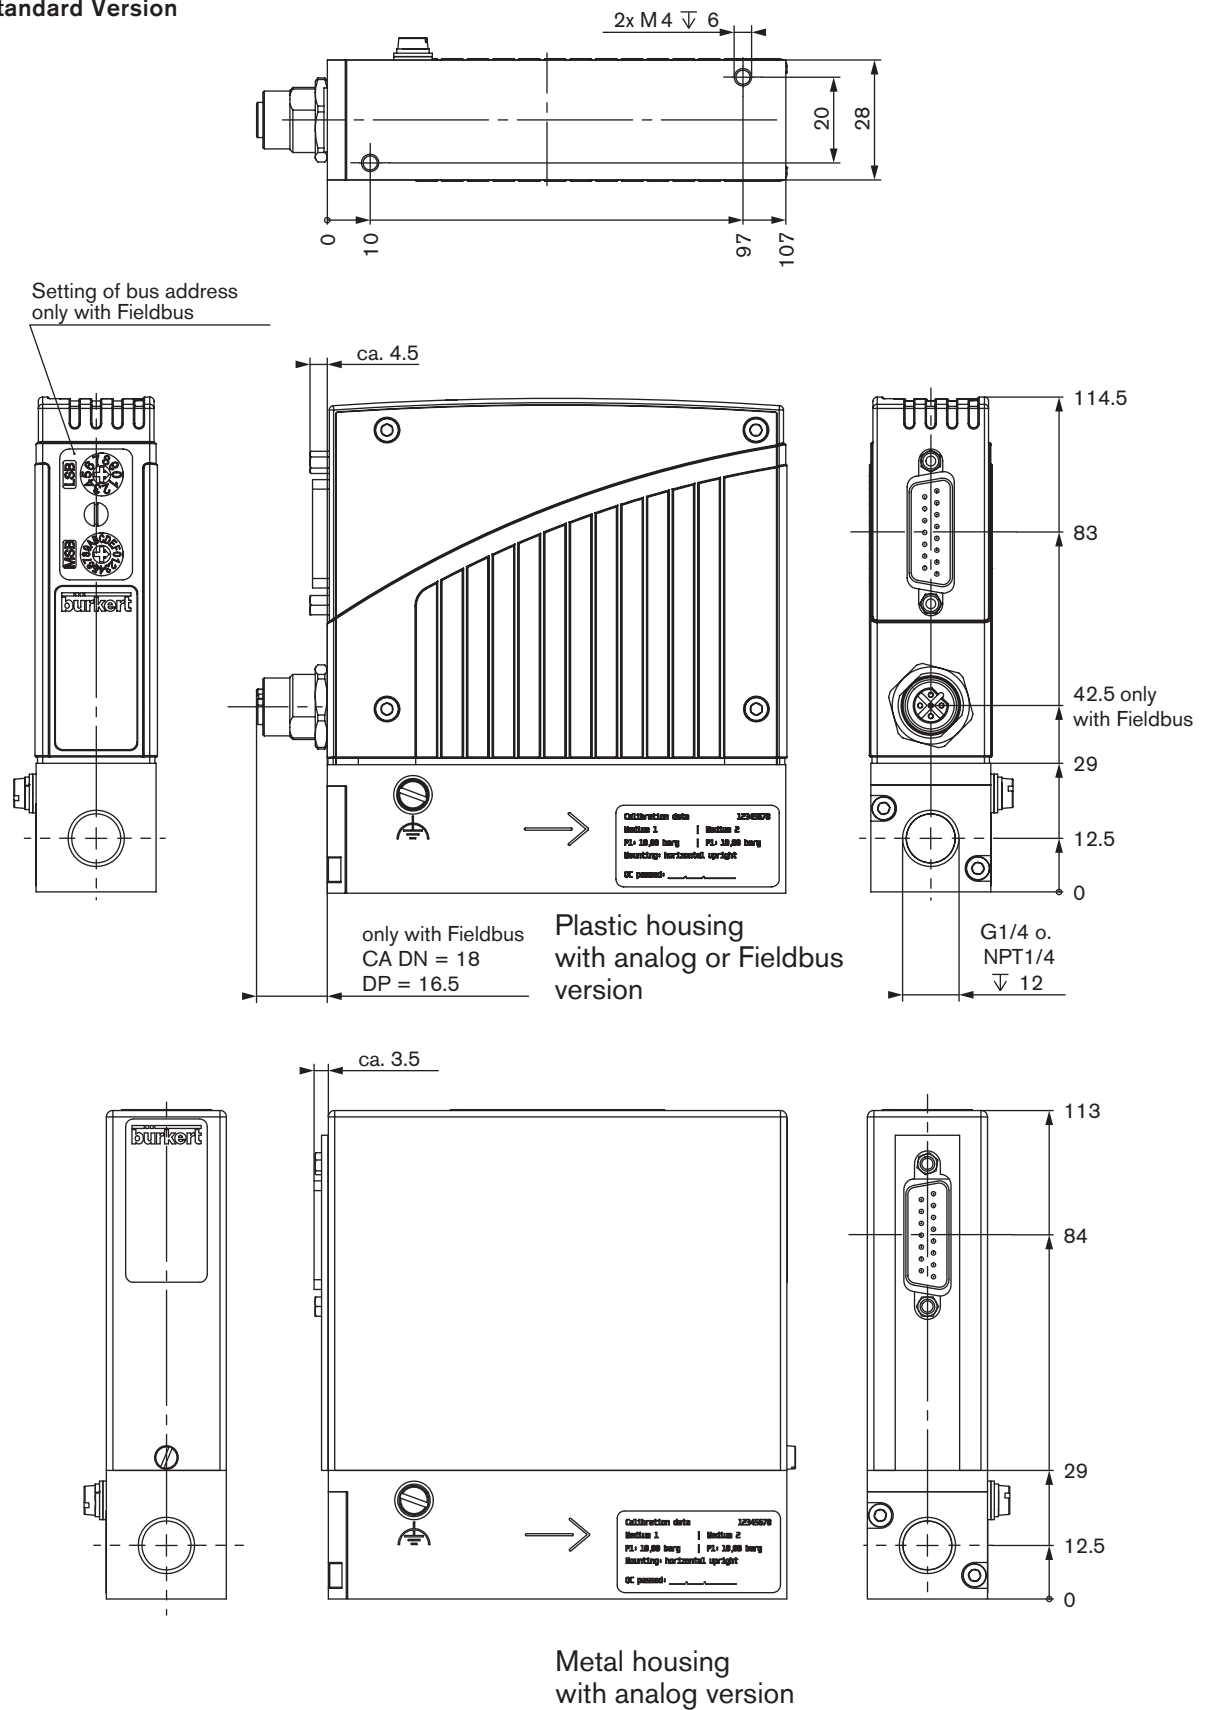


Dimensions [mm]

Subbase

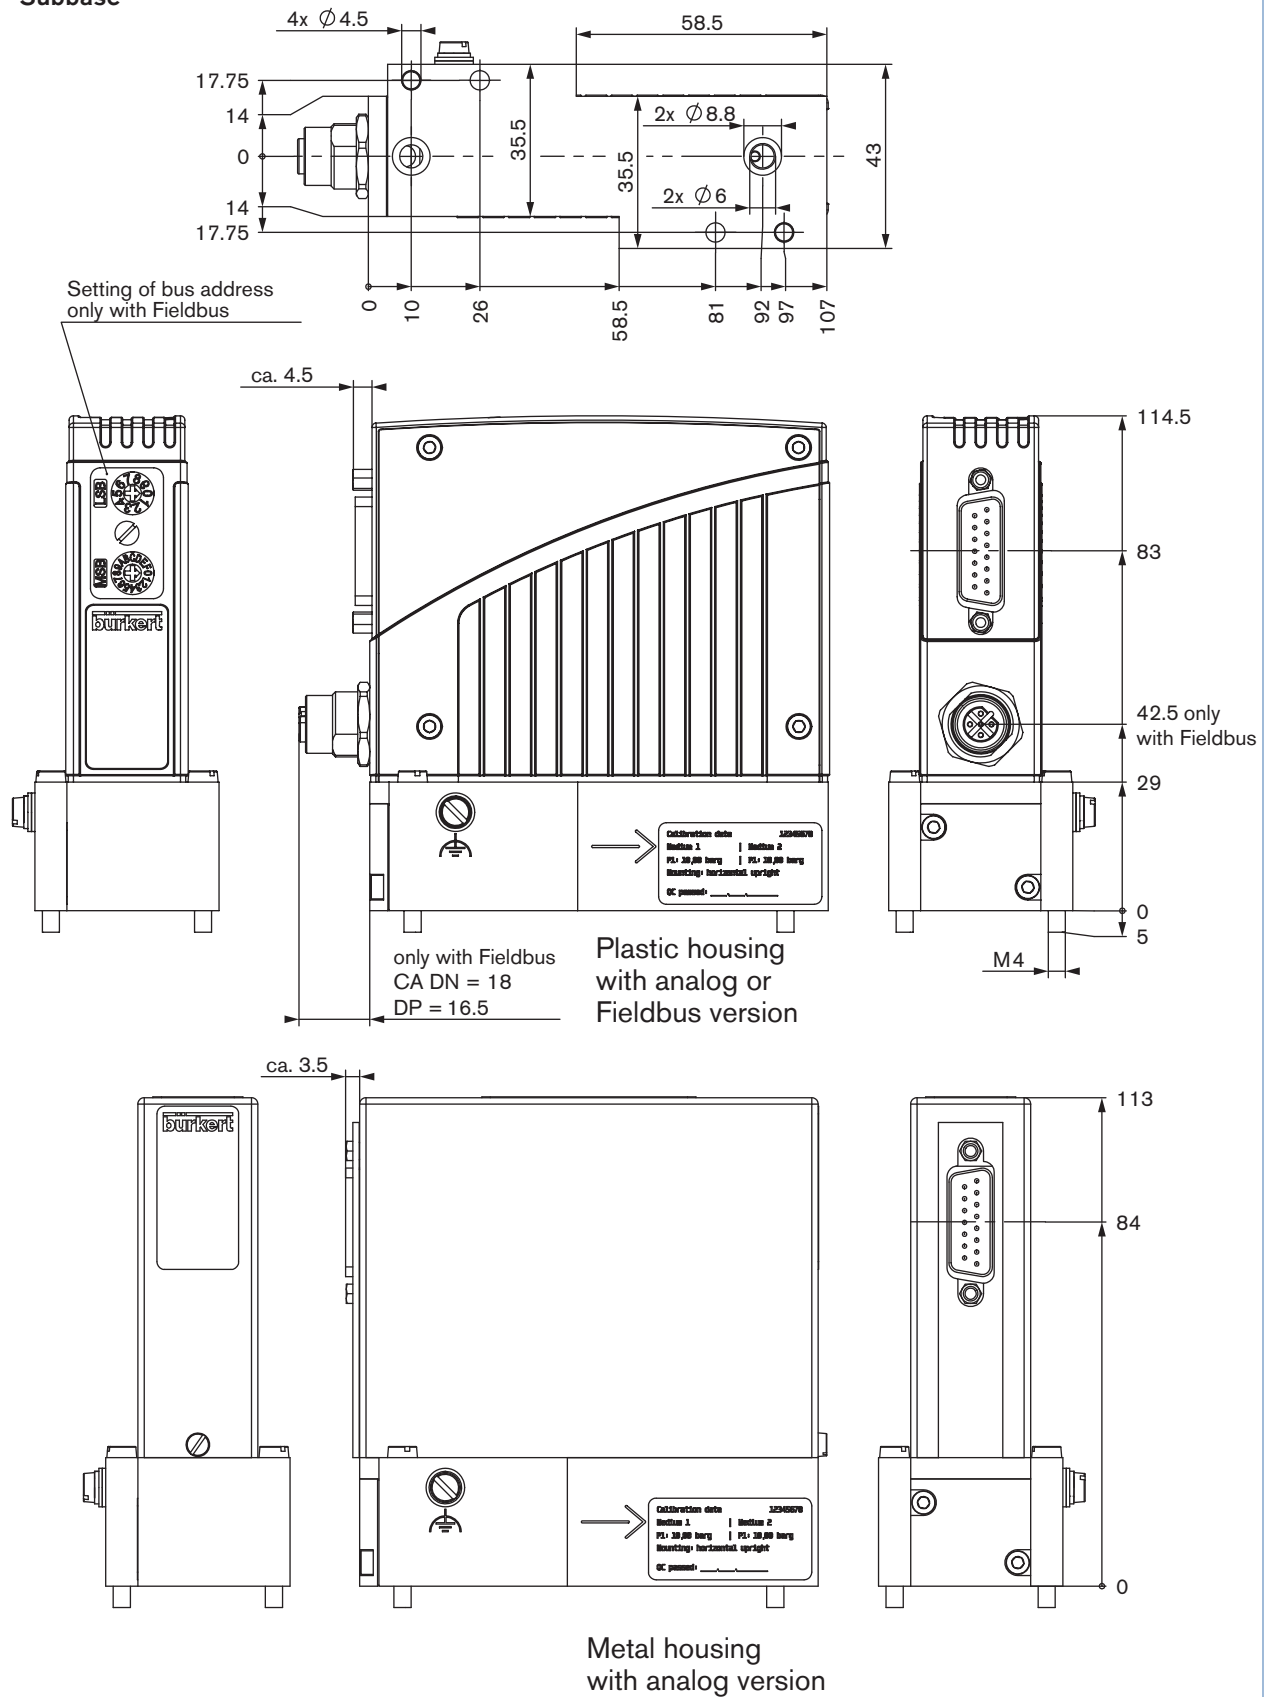

Dimensions [mm]

Version with external valve

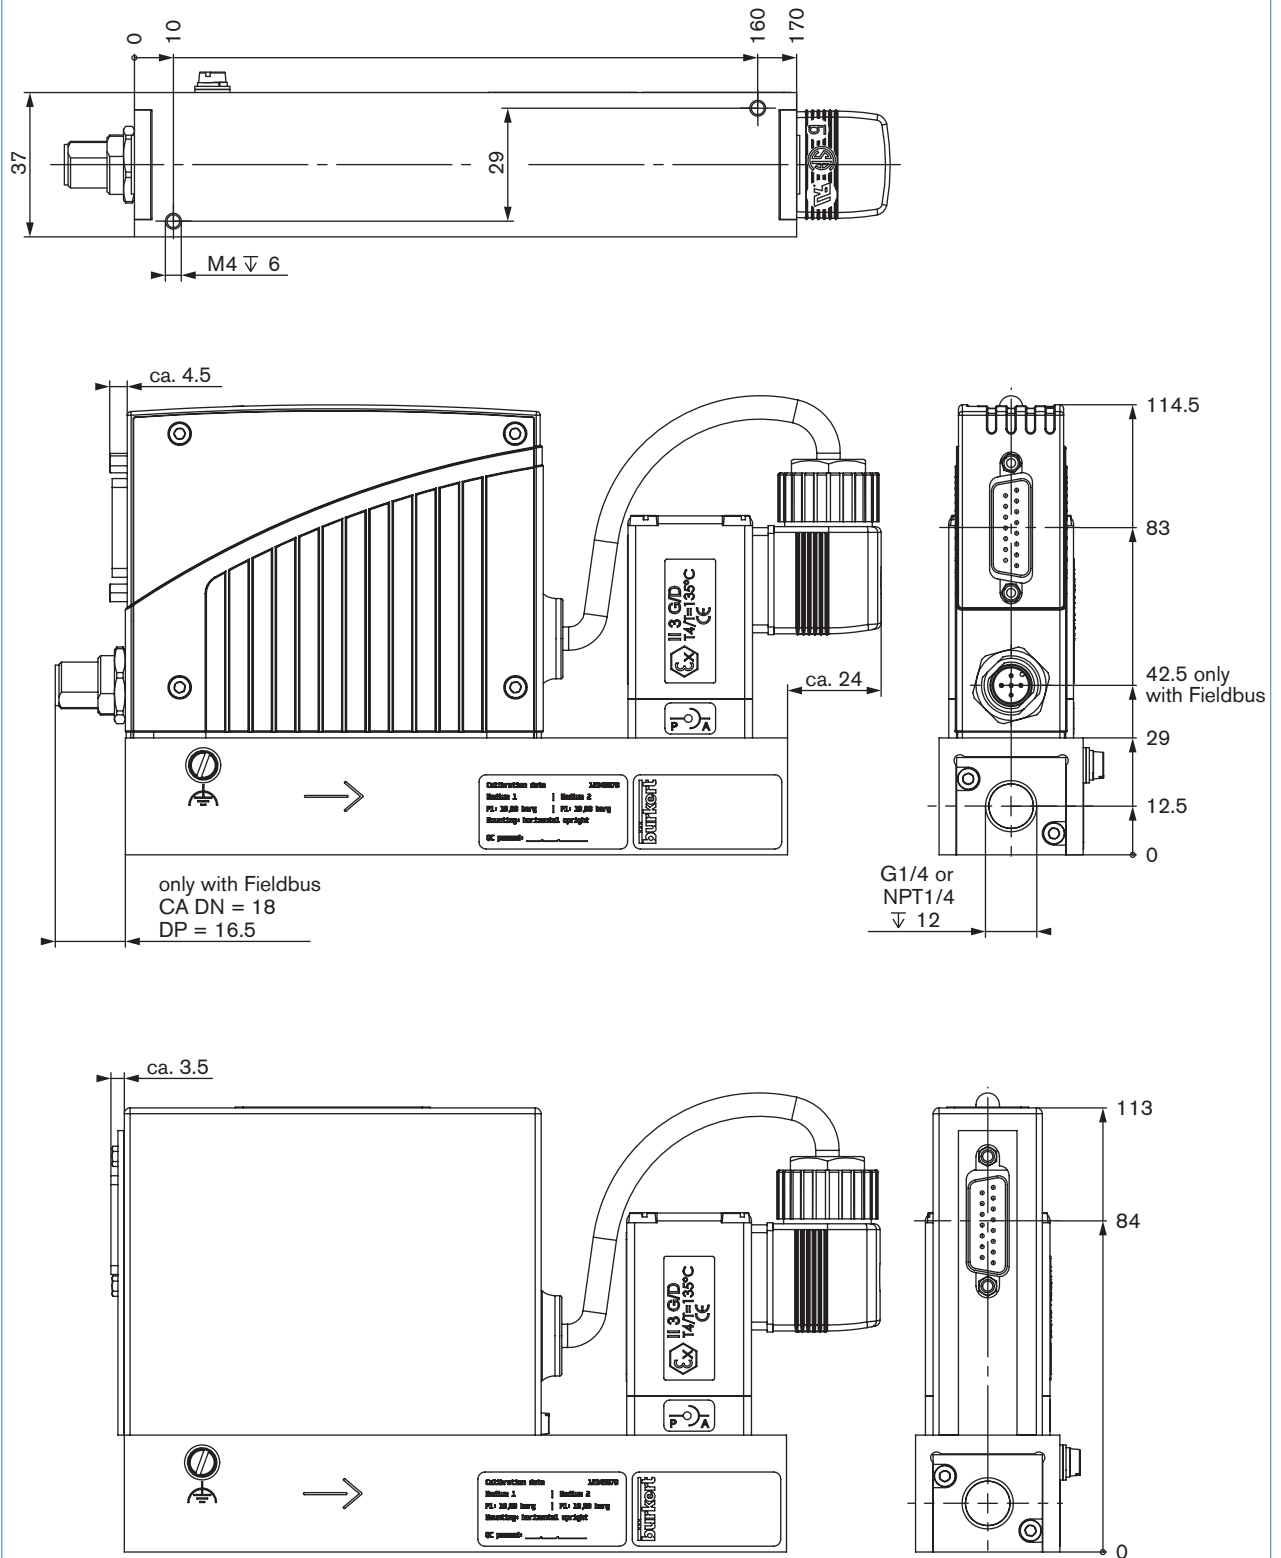

Note

You can fill out the fields directly in the PDF file before printing out the form.

MFC/MFM-applications - Request for quotation

▶ Please complete and send to your nearest Bürkert sales centre

| | |
|---------------|----------------|
| Company | Contact person |
| Customer No | Department |
| Address | Tel./Fax |
| Postcode/Town | E-mail |

☐ MFC-Application ☐ MFM-Application Quantity Required delivery date

Medium data

Type of gas (or gas proportion in mixtures)

Density kg/m³ ⁸⁾

Gas temperature [°C or °F] °C °F

Moisture content g/m³

Abrasive components/solid particles ☐ no ☐ yes, as follows:

Fluidic data

Flow range Q_{nom} Min. ☐ l_N/min ⁸⁾ ☐ l_S/min (slpm) ⁹⁾
 Max. ☐ m_N³/h ⁸⁾ ☐ kg/h
☐ cm_N³/min ⁸⁾ ☐ cm_S³/min (sccm) ⁹⁾
☐ l_N/h ⁸⁾ ☐ l_S/h ⁹⁾

Inlet pressure at Q_{nom} ¹⁰⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure P_{1max} bar(g) ■

MFC/MFM port connection ☐ without screw-in fitting
☐ 1/4" G-thread (DIN ISO 228/1)
☐ 1/4" NPT-thread (ANSI B1.2)
☐ with screw-in fitting (acc. to specification for pipeline)
 mm Pipeline (external Ø)
 inch Pipeline (external Ø)
☐ Flange version

Installation ☐ horizontal
☐ vertical, flow upwards ☐ vertical, flow downwards

Ambient temperature °C

Material data

Body base ☐ Aluminium ☐ Stainless steel

Body ☐ Plastic ☐ Metal (not with type 8712/8702 and not with fieldbus)

Seal ☐ FKM ☐ EPDM

Electrical data

| Signals for set point and actual value | with standard signal | with fieldbus |
|--|----------------------------------|--------------------------------------|
| | Setpoint | |
| | actual value | |
| | <input type="checkbox"/> 0-5 V | <input type="checkbox"/> 0-5 V |
| | <input type="checkbox"/> 0-10 V | <input type="checkbox"/> 0-10 V |
| | <input type="checkbox"/> 0-20 mA | <input type="checkbox"/> 0-20 mA |
| | <input type="checkbox"/> 4-20 mA | <input type="checkbox"/> 4-20 mA |
| | | <input type="checkbox"/> PROFIBUS DP |
| | | <input type="checkbox"/> DeviceNet |
| | | <input type="checkbox"/> CANopen |
| | | <input type="checkbox"/> M12 |
| | | <input type="checkbox"/> D-Sub |
| | | (only for type 8712/8702) |

■ Please quote all pressure values as overpressures with respect to atmospheric pressure bar(ü)

8) at: 1,013 bar(a) and 0°C

9) at: 1.013 bar (a) and 20°C

10) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box →



In case of special application conditions, please consult for advice.

Subject to alteration.
© Christian Bürkert GmbH & Co. KG

1501/8_EU-en_00891904



Type 8712 can be combined with...



Type 8619

Multichannel
program controller



Type 0330

2/2 or 3/2-way
solenoid valve



Type 6013

2/2-way
solenoid valve



Type 6606

2/2 or 3/2-way
solenoid valve

Mass Flow Controller (MFC) for Gases

- Direct flow measurement for nominal flow rates from 10 ml_N/min to 80 l_N/min (N₂) in MEMS technology
- High accuracy and repeatability
- Protection class IP65
- Optional field bus

Type 8712 controls the mass flow of gases that is relevant for most applications in process technology. The measured value provided by the sensor (see the description on page 2) will be compared in the digital control electronics with the predefined set point according to the signal; if a control difference is present, the control value output to the proportional valve will be modified using a PI-control algorithm.

Due to the fact that the sensor is directly placed in the bypass channel a very short settling time of the MFC is reached. In this way, the mass flow can be maintained at a fixed value or a predefined profile can be followed, regardless of pressure variations or other changes in the system.

Type 8712 can optionally be calibrated for two different gases, the user is able to switch between these two gases. As the control element, a proportional valve working at low friction guarantees a high sensitivity and a good control characteristics of the unit. The MassFlowCommunicator software can be used for parameterisation and diagnosis.

Typical application areas are gas dosing or rather the production of gas mixtures in:

- Pharmaceutical industry
- Food and beverage
- Environmental technology
- Heat treatment

| Technische Daten | |
|---|---|
| Nominal flow range ¹⁾ (Q_{nom}) | 0.01 ml _N /min ²⁾ to 80 l _N /min (N ₂) |
| Turn-down ratio | 1:50, wider span on request |
| Operating gas | Neutral, non-contaminated gases, others available on request |
| Calibration gas | Operating gas or air with correcting function |
| Max. operating pressure (inlet pressure) | Up to max. 10 bar (145psi), depending on the orifice of the valve |
| Gas temperature | -10 to +70°C (-10 to +60°C with oxygen) |
| Ambient temperature | -10 to +50°C |
| Accuracy (after 1 min warm up time) | ±0.8% o.R. ±0.3% F.S. (o.R.: of reading; F.S.: of full scale) |
| Repeatability | ±0.1% F.S. |
| Settling time (t_{95%}) | <300ms |
| Materials Body Housing Seals | Stainless steel PC (Polycarbonate) FKM, EPDM (others on request) |
| Port connection | G 1/4", NPT 1/4" or compression fitting |
| Control valve Valve orifice k _v value | Normally closed 0.05 to 4 mm 0.00006 to 0.32 m³/h |
| Electr. connection Additionally with fieldbus: | Socket M16, round, 8-pin and socket D-Sub HD15, 15-pin With PROFIBUS-DP: Socket M12 5-pin (for IP65) or D-Sub 9-pin With DeviceNet/CANopen: Plug M12 5-pin (for IP65) or D-Sub 9-pin |
| Operating voltage | 24V DC |
| Voltage tolerance | ±10% |
| Residual ripple | <2% |
| Power consumption | 3.5–14 W (depending on version) |

¹⁾ The nominal flow value is the max. flow value calibrated which can be controlled. The nominal flow range defines the range of nominal flow rates (full scale values) possible.

²⁾ Index N: Flow rates referred to 1.013 bar and 0° C.

Alternatively there is an Index S available which refers to 1.013 bar and 20° C.

Technical data


| Technical data (cont.) | |
|---|---|
| Set point (signal setting) Feed impedance | 0–5V, 0–10V, 0–20 mA or 4–20 mA >20 k Ω (voltage) <300 Ω (current) |
| Output signal (signal output) Max. current, volt. output Max. load, current output | 0–5 V, 0–10 V, 0–20 mA or 4–20 mA 10 mA 600 Ω |
| Digital communication via adapter possible: | RS232, Modbus RTU (via RS interface) RS485, RS422 or USB (see accessories table on p. 3) |
| Fieldbus option | PROFIBUS-DP, DeviceNet, CANopen (D-Sub HD15 covered with sealed plate with fieldbus MFC) |
| Type of protection (with connected cables) | IP65 |
| Dimensions [mm] (without fitting) | See drawings on p. 6–8 |
| Total weight | 1200 g (Valve internally) |
| Mounting position | Horizontal or vertical |
| Light emitting diodes (Default, other functions programmable) | Indication for 1. Power, 3. Limit 2. Communication 4. Error |
| Binary inputs (Default, other functions programmable) | Three 1. Start Autotune 2. Not assigned, Switch between gases when cal. for two gases 3. Not assigned |
| Binary outputs (Default, other functions programmable) | Two relay outputs 1. Limit (desired value can not be achieved) 2. Error (e.g. sensor fault) Load capacity: max. 60 V, 1 A, 60 VA |

Nominal Flow Range of Typical Gases

(other gases on request)

| Gas | Min. Q_{nom} [l _N /min] | Max. Q_{nom} [l _N /min] |
|----------------|---|---|
| Argon | 0.01 | 80 |
| Helium | 0.01 | 500 |
| Carbon dioxide | 0.02 | 40 |
| Air | 0.01 | 80 |
| Methane | 0.01 | 80 |
| Oxygen | 0.01 | 80 |
| Nitrogen | 0.01 | 80 |
| Hydrogen | 0.01 | 500 |

Measuring Principle

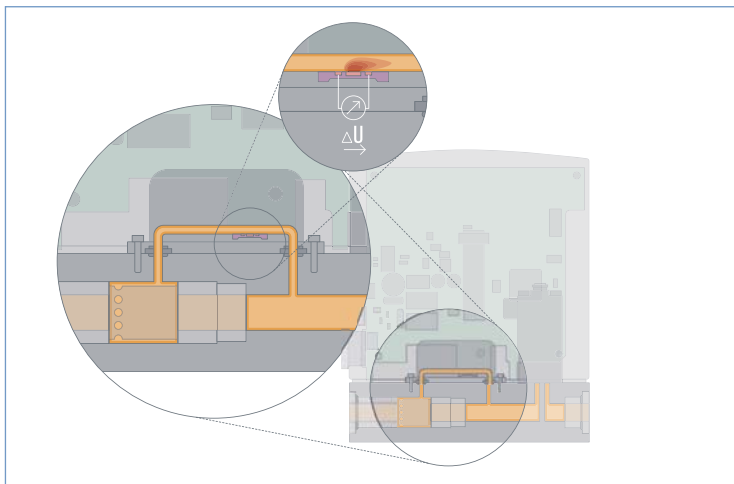

The actual flow rate is detected by a sensor. This operates according to a thermal principle which has the advantage of providing the mass flow which is independent on pressure and temperature.

A small part of the total gas stream is diverted into a small, specifically designed bypassing channel which ensures laminar flow conditions.

The sensor element is a chip immersed into the wall of this flow channel. The chip, produced in MEMS technology, contains a heating resistor and two temperature sensors (thermopiles) which are arranged symmetrically upstream and downstream of the heater. The differential voltage of the thermopiles is a measure of the mass flow rate passing the flow sensor. The calibration procedure effectuates a unique assignment of the sensor signal to the total flow rate through the device.

Notes Regarding the Configuration

For the proper choice of the actuator orifice within the MFC, not only the required maximum flow rate Q_{nom} , but also the pressure values *directly* before and after the MFC (p_1 , p_2) at this flow rate Q_{nom} should be known. In general, these pressures are not the same as the overall inlet and outlet pressures of the whole plant, because usually there are additional flow resistors (tubing, additional shut-off valves, nozzles etc.) present both before and after the controller.

Please use the request for quotation form on p. 9 to indicate the pressures *directly* before and after the MFC. If these should be unknown

or not accessible to a measurement, estimates are to be made by taking into account the approximate pressure drops over the flow resistors before and after the MFC, respectively, at a flow rate of Q_{nom} . In addition, please quote the maximum inlet pressure p_{1max} to be encountered. This data is needed to make sure the actuator is able to provide a close-tight function within all the specified modes of operation.


► Please use the form on page 8 for the information about your specific requirements..

Ordering Chart for Accessories


| Article | Item No. | |
|---|------------------------------------|--|
| Connectors/Cables | | |
| Round plug M16 8-pin (solder connection) | 918 299 | |
| Round plug M16 8-pin with 5m cable | 787 733 | |
| Round plug M16 8-pin with 10m cable | 787 734 | |
| Plug D-Sub HD15 15-pin with 5m cable | 787 735 | |
| Plug D-Sub HD15 15-pin with 10m cable | 787 736 | |
| Adapters ³⁾ | | |
| RS232 adapter for connection to a computer, connection with an extension cable (item no. 917 039) | 654 757 | |
| Extension cable for RS232 9-pin socket/plug 2 m | 917 039 | |
| RS422-Adapter (RS485 compatible) | 666 370 | |
| USB-Adapter (Version 1.1, USB socket type B) | 670 696 | |
| USB connection cable 2 m | 772 299 | |
| Adapter for manual setting of bus address | 667 525 | |
| Software MassFlowCommunicator | Download unter www.buerkert.com | |
| Accessories for Fieldbus | PROFIBUS DP (B-codiert) | DeviceNet/ CAN- open (A-codiert) |
| M12-Plug ⁴⁾ | 918 198 | 917 115 |
| M12-socket (coupling) ⁴⁾ | 918 447 | 917 116 |
| Y-junction ⁴⁾ | 902 098 | 788 643 |
| T-junction | 918 531 | (auf Anfrage) |
| Shut-off resistor | 902 553 | (auf Anfrage) |
| GSD-Datei (PROFIBUS), EDS-Datei (DeviceNet, CANopen) | Download unter www.buerkert.com | |

³⁾ The adapters serve mainly for initial operation or diagnosis. Those are not obligatory for continuous operation.


⁴⁾ The two M12 connectors as listed above cannot be used together on the same side of the Y-junction. At least one of the two M12 connection needs to be a prefabricated cable which uses typically a thinner connector.

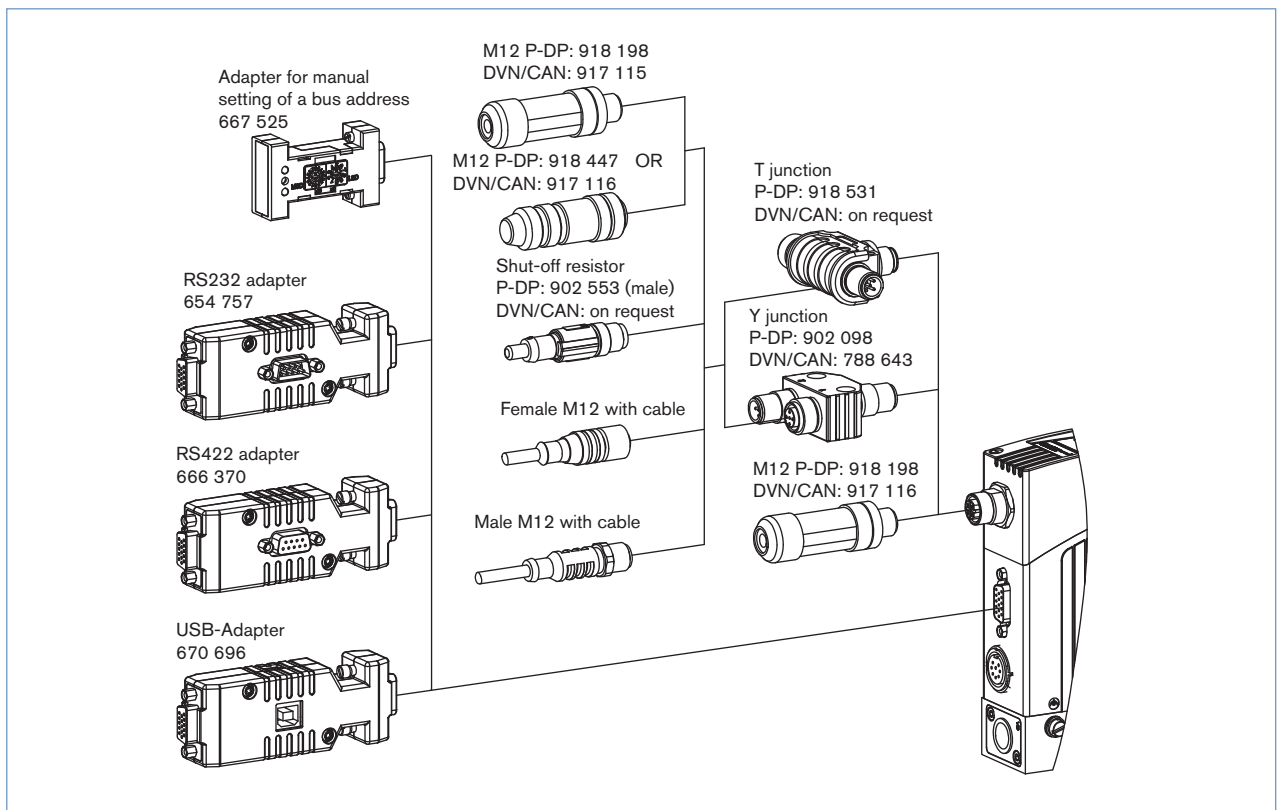

Pin Assignment

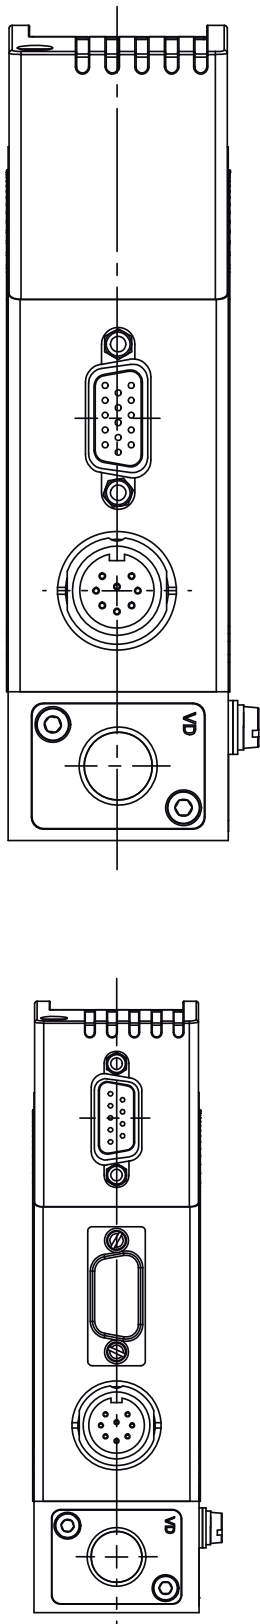

Socket D-Sub HD15

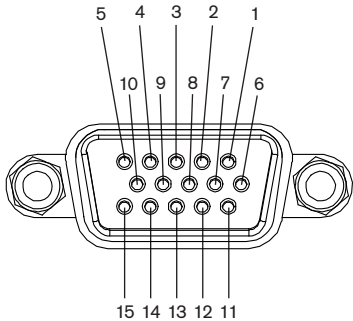


| Pin | Assignment | |
|-----|--|--------------------|
| | Analogue Control | Bus control |
| 1 | Set value input + | N.C. ⁵⁾ |
| 2 | Set value input GND | N.C. |
| 3 | Actual value output + | N.C. |
| 4 | Binary input 2 | |
| 5 | 12V-Output (only for internal company use) | |
| 6 | RS232 TxD (direct connection to computer) | |
| 7 | Binary input 1 | |
| 8 | GND (for binary inputs) | |
| 9 | only company internal use (do not connect!) | |
| 10 | 12V-Output (only for internal company use) | |
| 11 | 12V-Output (only for internal company use) | |
| 12 | Binary input 3 | |
| 13 | Actual value output GND | N.C. |
| 14 | RS232 RxD (direct connection to computer) | |
| 15 | DGND (for RS232-interface) | |

⁵⁾ N.C.: not connected (not used)

Note:

- Optional Pin 1 and 2 with bus version as transmitter input possible
- The cable length for RS232/ Setpoint and flow value signal is limited to 30 meters.


Socket M16, round, 8-pin

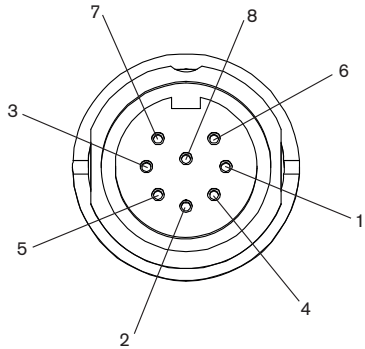

| Pin | Assignment |
|-----|-----------------------------------|
| 1 | 24V-Supply + |
| 2 | Relay 1 – reference contact |
| 3 | Relay 2 – reference contact |
| 4 | Relay 1 – normally closed contact |
| 5 | Relay 1 – normally open contact |
| 6 | 24V-Supply GND |
| 7 | Relay 2 – normally open contact |
| 8 | Relay 2 – normally closed contact |


Socket D-Sub 9-pin



(only with fieldbus version)

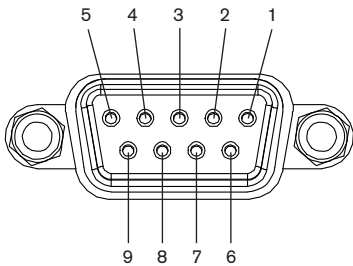



| Pin | Assignment | |
|-----|--------------------------------------|-----------------------|
| | PROFIBUS DP | DeviceNet/ CANopen |
| 1 | Shield | Shield |
| 2 | N.C. | CAN-L data line |
| 3 | RxD/TxD - P (B-line) | GND |
| 4 | RTS (control signal for repeater) | N.C. |
| 5 | GND | N.C. |
| 6 | VDD (only for termination resistor) | N.C. |
| 7 | N.C. | CAN-H data line |
| 8 | RxD/TxD - N (A-line) | N.C. |
| 9 | N.C. | N.C. |

Pin Assignment (continued)

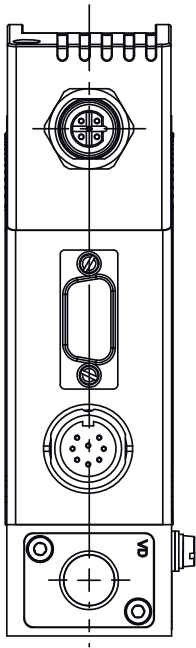
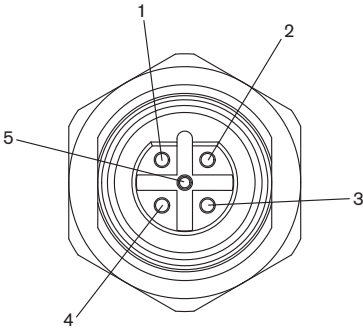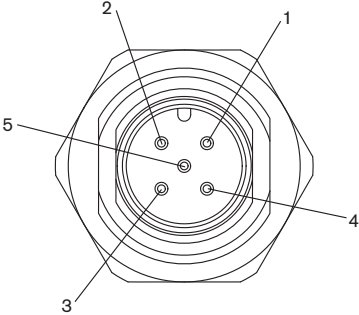
| PROFIBUS DP – socket B-coded M12 (DPV1 max. 12 Mbaud) | Pin | Assignment |
|---|-----|-------------------------------------|
|  | 1 | VDD (only for termination resistor) |
| | 2 | RxD/TxD – N (A-line) |
| | 3 | DGND |
| | 4 | RxD/TxD – P (B-line) |
| | 5 | N.C. |
| DeviceNet/ CANopen – Plug A-coded M12 | Pin | Assignment |
|  | 1 | Shield |
| | 2 | N.C. ⁶⁾ |
| | 3 | DGND |
| | 4 | CAN_H |
| | 5 | CAN_L |
| ⁶⁾ Optional configuration with 24V DC possible for power supply via fieldbus connector. With this no power supply connection on round M16 plug needed. | | |


Dimensions [mm]

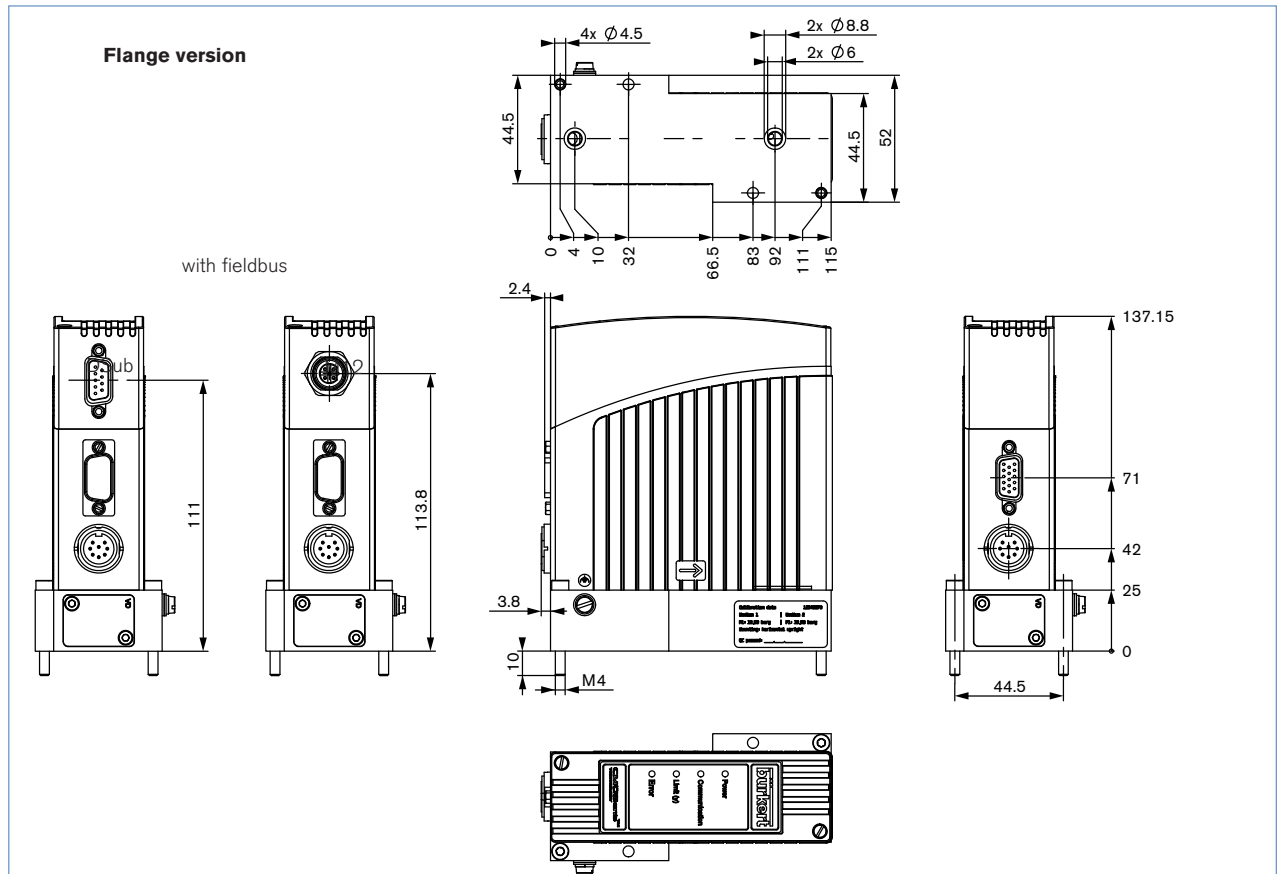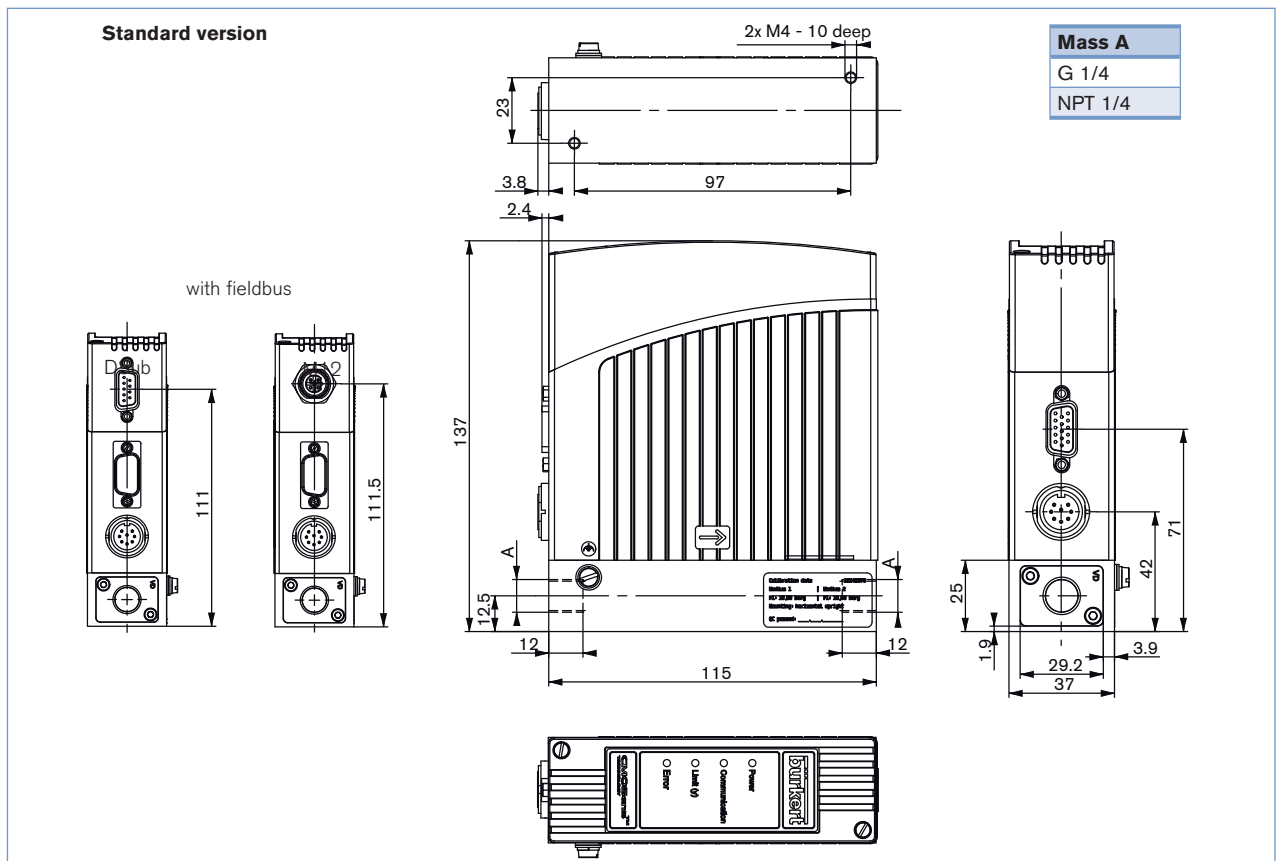

Dimensions [mm] (continued)

Version with external valve


Variants of fieldbus connectors please see on previous pages.

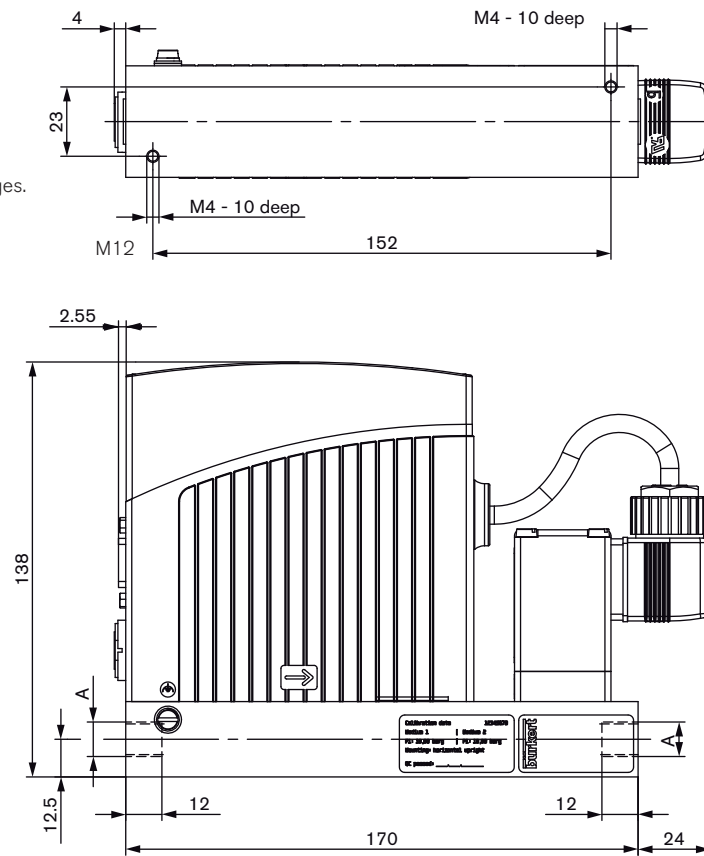

Mass A

G 1/4

NPT 1/4

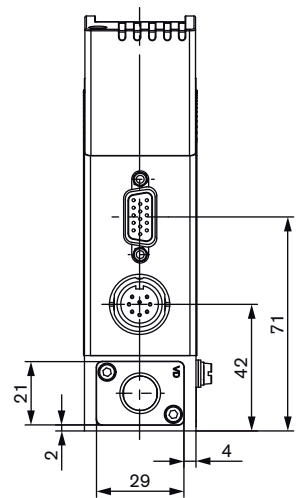

Note

You can fill out the fields directly in the PDF file before printing out the form.

MFC/MFM-applications - Request for quotation

Please complete and send to your nearest Bürkert sales centre

| | |
|---------------|----------------|
| Company | Contact person |
| Customer No | Department |
| Address | Tel./Fax |
| Postcode/Town | E-mail |

☐ MFC-Application ☐ MFM-Application Quantity Required delivery date

Medium data

Type of gas (or gas proportion in mixtures)

Density kg/m³ ⁷⁾

Gas temperature [°C or °F] °C °F

Moisture content g/m³

Abrasive components/solid particles ☐ no ☐ yes, as follows:

Fluidic data

Flow range Q_{nom} Min. ☐ l_N/min ⁷⁾ ☐ l_S/min (slpm) ⁸⁾
 Max. ☐ m_N³/h ⁷⁾ ☐ kg/h
☐ cm_N³/min ⁷⁾ ☐ cm_S³/min (sccm) ⁸⁾
☐ l_N/h ⁷⁾ ☐ l_S/h ⁸⁾

Inlet pressure at Q_{nom} ⁹⁾ $p_1 =$ bar(g) ■

Outlet pressure at Q_{nom} $p_2 =$ bar(g) ■

Max. inlet pressure P_{1max} bar(g) ■

MFC/MFM port connection ☐ without screw-in fitting
☐ 1/4" G-thread (DIN ISO 228/1)
☐ 1/4" NPT-thread (ANSI B1.2)
☐ with screw-in fitting (acc. to specification for pipeline)
 mm Pipeline (external Ø)
 inch Pipeline (external Ø)
☐ Flange version

Installation ☐ horizontal
☐ vertical, flow upwards ☐ vertical, flow downwards

Ambient temperature °C

Material data

Body ☐ Aluminium ☐ Stainless steel

Housing ☐ Plastic ☐ Metal (not with type 8712/8702 and not with fieldbus)

Seal ☐ FKM ☐ EPDM

Electrical data

| Signals for set point and actual value | with standard signal | with fieldbus |
|--|---|---|
| | Setpoint | |
| | actual value | |
| | <input type="checkbox"/> 0-5 V <input type="checkbox"/> 0-5 V | <input type="checkbox"/> PROFIBUS DP <input type="checkbox"/> M12 |
| | <input type="checkbox"/> 0-10 V <input type="checkbox"/> 0-10 V | <input type="checkbox"/> DeviceNet <input type="checkbox"/> D-Sub |
| | <input type="checkbox"/> 0-20 mA <input type="checkbox"/> 0-20 mA | <input type="checkbox"/> CANopen (only for type 8712/8702) |
| | <input type="checkbox"/> 4-20 mA <input type="checkbox"/> 4-20 mA | |

■ Please quote all pressure values as overpressures with respect to atmospheric pressure bar(ü)

7) at: 1,013 bar(a) and 0°C

8) at: 1.013 bar (a) and 20°C

9) matches with calibration pressure

To find your nearest Bürkert facility, click on the orange box



In case of special application conditions, please consult for advice.

Subject to alteration.
© Christian Bürkert GmbH & Co. KG

1501/8_EU-en_00891857

По вопросам продаж и поддержки обращайтесь:

| | | | |
|---------------------------------|----------------------------------|------------------------------------|-------------------------------|
| Архангельск +7 (8182) 45-71-35 | Калининград +7 (4012) 72-21-36 | Новороссийск +7 (8617) 30-82-64 | Сочи +7 (862) 279-22-65 |
| Астана +7 (7172) 69-68-15 | Калуга +7 (4842) 33-35-03 | Новосибирск +7 (383) 235-95-48 | Ставрополь +7 (8652) 57-76-63 |
| Астрахань +7 (8512) 99-46-80 | Кемерово +7 (3842) 21-56-70 | Омск +7 (381) 299-16-70 | Сургут +7 (3462) 77-96-35 |
| Барнаул +7 (3852) 37-96-76 | Киров +7 (8332) 20-58-70 | Орел +7 (4862) 22-23-86 | Сызрань +7 (8464) 33-50-64 |
| Белгород +7 (4722) 20-58-80 | Краснодар +7 (861) 238-86-59 | Оренбург +7 (3532) 48-64-35 | Сыктывкар +7 (8212) 28-83-02 |
| Брянск +7 (4832) 32-17-25 | Красноярск +7 (391) 989-82-67 | Пенза +7 (8412) 23-52-98 | Тверь +7 (4822) 39-50-56 |
| Владивосток +7 (4232) 49-26-85 | Курск +7 (4712) 23-80-45 | Первоуральск +7 (3439) 26-01-18 | Томск +7 (3822) 48-95-05 |
| Владимир +7 (4922) 49-51-33 | Липецк +7 (4742) 20-01-75 | Пермь +7 (342) 233-81-65 | Тула +7 (4872) 44-05-30 |
| Волгоград +7 (8442) 45-94-42 | Магнитогорск +7 (3519) 51-02-81 | Ростов-на-Дону +7 (863) 309-14-65 | Тюмень +7 (3452) 56-94-75 |
| Воронеж +7 (4732) 12-26-70 | Москва +7 (499) 404-24-72 | Рязань +7 (4912) 77-61-95 | Ульяновск +7 (8422) 42-51-95 |
| Екатеринбург +7 (343) 302-14-75 | Мурманск +7 (8152) 65-52-70 | Самара +7 (846) 219-28-25 | Уфа +7 (347) 258-82-65 |
| Иваново +7 (4932) 70-02-95 | Наб.Челны +7 (8552) 91-01-32 | Санкт-Петербург +7 (812) 660-57-09 | Хабаровск +7 (421) 292-95-69 |
| Ижевск +7 (3412) 20-90-75 | Ниж.Новгород +7 (831) 200-34-65 | Саранск +7 (8342) 22-95-16 | Чебоксары +7 (8352) 28-50-89 |
| Иркутск +7 (3952) 56-24-09 | Нижневартовск +7 (3466) 48-22-23 | Саратов +7 (845) 239-86-35 | Челябинск +7 (351) 277-89-65 |
| Йошкар-Ола +7 (8362) 38-66-61 | Нижнекамск +7 (8555) 24-47-85 | Смоленск +7 (4812) 51-55-32 | Череповец +7 (8202) 49-07-18 |
| Казань +7 (843) 207-19-05 | | | Ярославль +7 (4852) 67-02-35 |

сайт: burkert.pro-solution.ru | эл. почта: btk@pro-solution.ru
телефон: 8 800 511 88 70